


RAFT SLAB  
SCALE 1:50

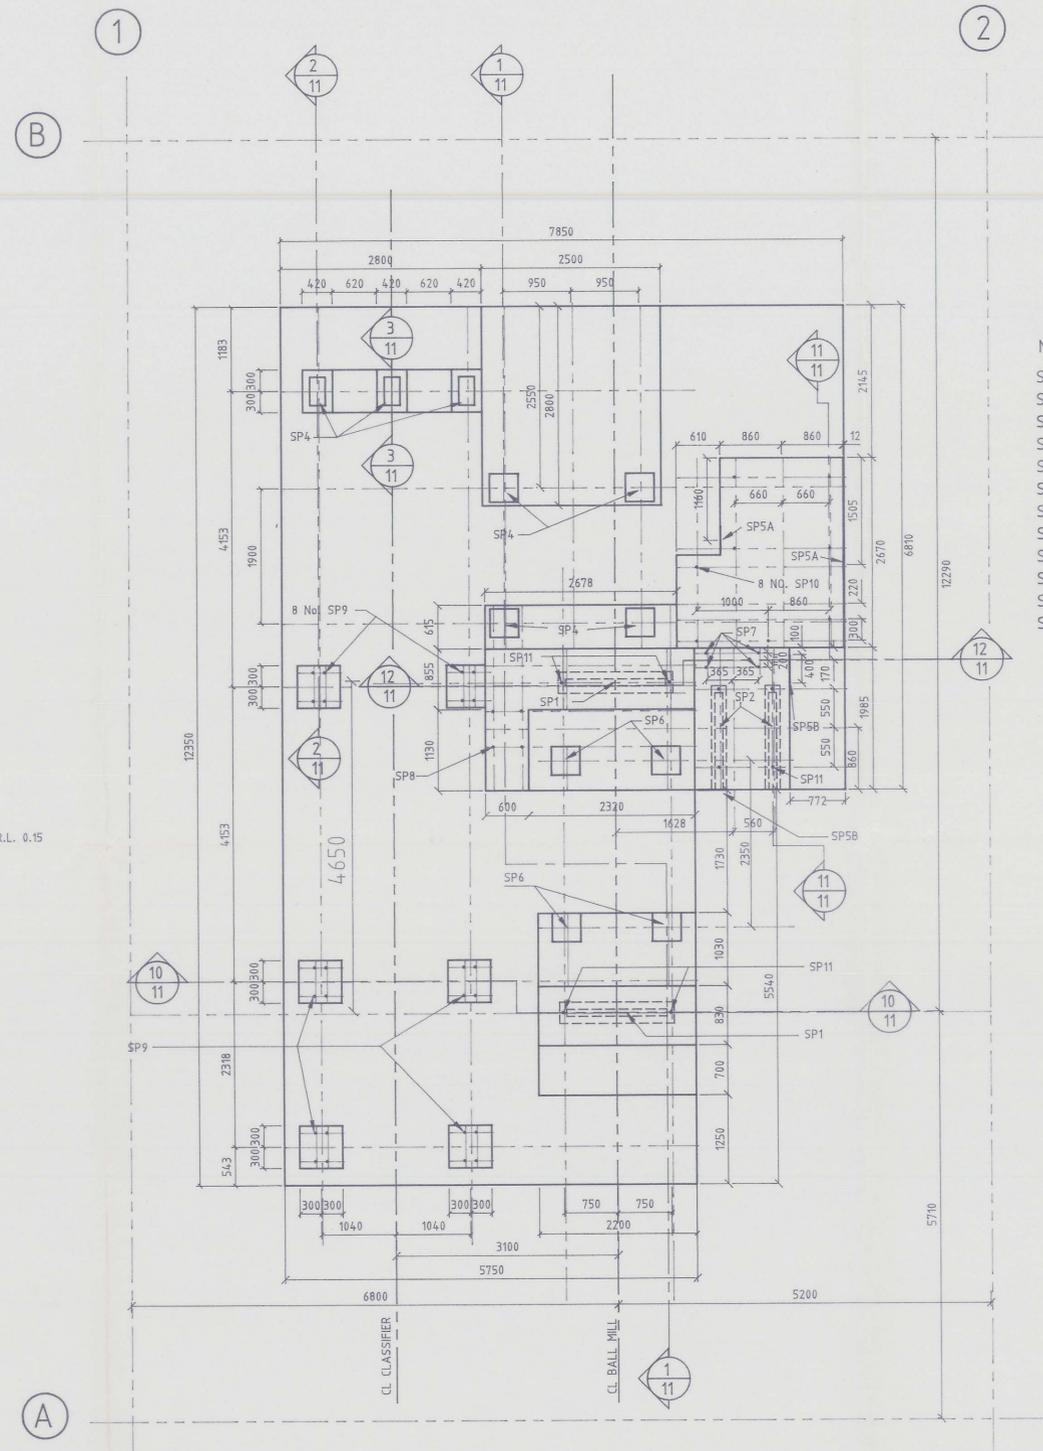


FOUNDATION SLAB  
SCALE 1:50

SCHEDULE OF EMBEDDED ITEMS

| No.  | DESCRIPTION              | NUMBER | SUPPLIER   |
|------|--------------------------|--------|------------|
| SP1  | STEEL SPECIAL            | 2      | RILTEC     |
| SP2  | STEEL SPECIAL            | 2      | RILTEC     |
| SP3  | STEEL SPECIAL            | 3.8    | RILTEC     |
| SP4  | STEEL SPECIAL            | 7      | RILTEC     |
| SP5A | STEEL SPECIAL            | 2      | RILTEC     |
| SP5B | STEEL SPECIAL            | 2      | RILTEC     |
| SP6  | STEEL SPECIAL            | 4      | RILTEC     |
| SP7  | M16 x 400 LONG HD BOLTS  | 4      | CONTRACTOR |
| SP8  | M24 x 800 LONG HD BOLTS  | 4      | CONTRACTOR |
| SP9  | M30 x 1250 LONG HD BOLTS | 24     | CONTRACTOR |
| SP10 | M36 x 1000 LONG HD BOLTS | 8      | CONTRACTOR |
| SP11 | M42 x 2300 LONG HD BOLTS | 8      | CONTRACTOR |

NOTES

- ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH AUSTRALIAN STANDARD AS 3600.
- MASS CONCRETE FOOTINGS AND BLINDING CONCRETE SHALL BE CLASS 15.
- SLAB ON GRADE SHALL BE CLASS 25.
- MINIMUM COVER TO REINFORCEMENT SHALL BE 20mm.
- FORMWORK SHALL BE CLASS 3 WITH TYPE C COLOUR CONTROL.
- EXPOSED CONCRETE SLAB SURFACES SHALL BE STEEL FLOAT FINISHED TO A CLASS B SURFACE.
- CURING OF CONCRETE SHALL BE BY THE APPLICATION OF A MEMBRANE SYSTEM.



| Rev. No. | Description                                   | Date    |
|----------|---|---------|
| 1        | SECTIONS 10,11,12 ADDED, FALLS & LEVELS ADDED | 2/11/93 |

**Thompson & Brett Pty. Ltd.**  
Consulting Engineers  
7 Bayfield Street, Rosny Park, 7018  
Phone (002) 446633 Fax. (002) 446221

Drawn E.B. Date 10-1993 Scale 1:50  
Approved [Signature] Director  
File BOUTY-01 Geocomp

Client & Project  
**RILTEC (TASMANIA) PTY LTD**  
**GOLDEN GATE TAILINGS RE-TREATMENT**

Drawing Title  
**BALL MILL FOUNDATIONS**  
**SLAB PLANS**  
Drawing No. 93-976-10 REV 1

0121\_022

0015/0007

0015