


LEGEND

- ① MAIN CABLES 37/083 BR. DIRECT GROUND
- ② DERRICK CRANE SUB-MAINS 37/064 BR DIRECT IN GROUND & IN P.V.C PIPE
- ③ LIFTING GANTRY SUB-MAINS 7/036 PVC/PVC 2" Ø G.I.W.P. THEN IN 2" Ø PVC PIPE
- ④ OFFICE & AMENITIES SUB MAINS 7/036 PVC/PVC 2" Ø G.I.W.P.
- ⑤ MAIN GATE SECURITY LIGHTING 3/036 PVC/PVC IN 2" Ø G.I.W.P THEN IN 1" Ø G.I.W.P.
- ⑥ FIRE ALARM CIRCUIT TO OFFICE & AMENITIES M.D.F. 0.002 M.I.M.S IN PVC SHEATH LAY U/G.

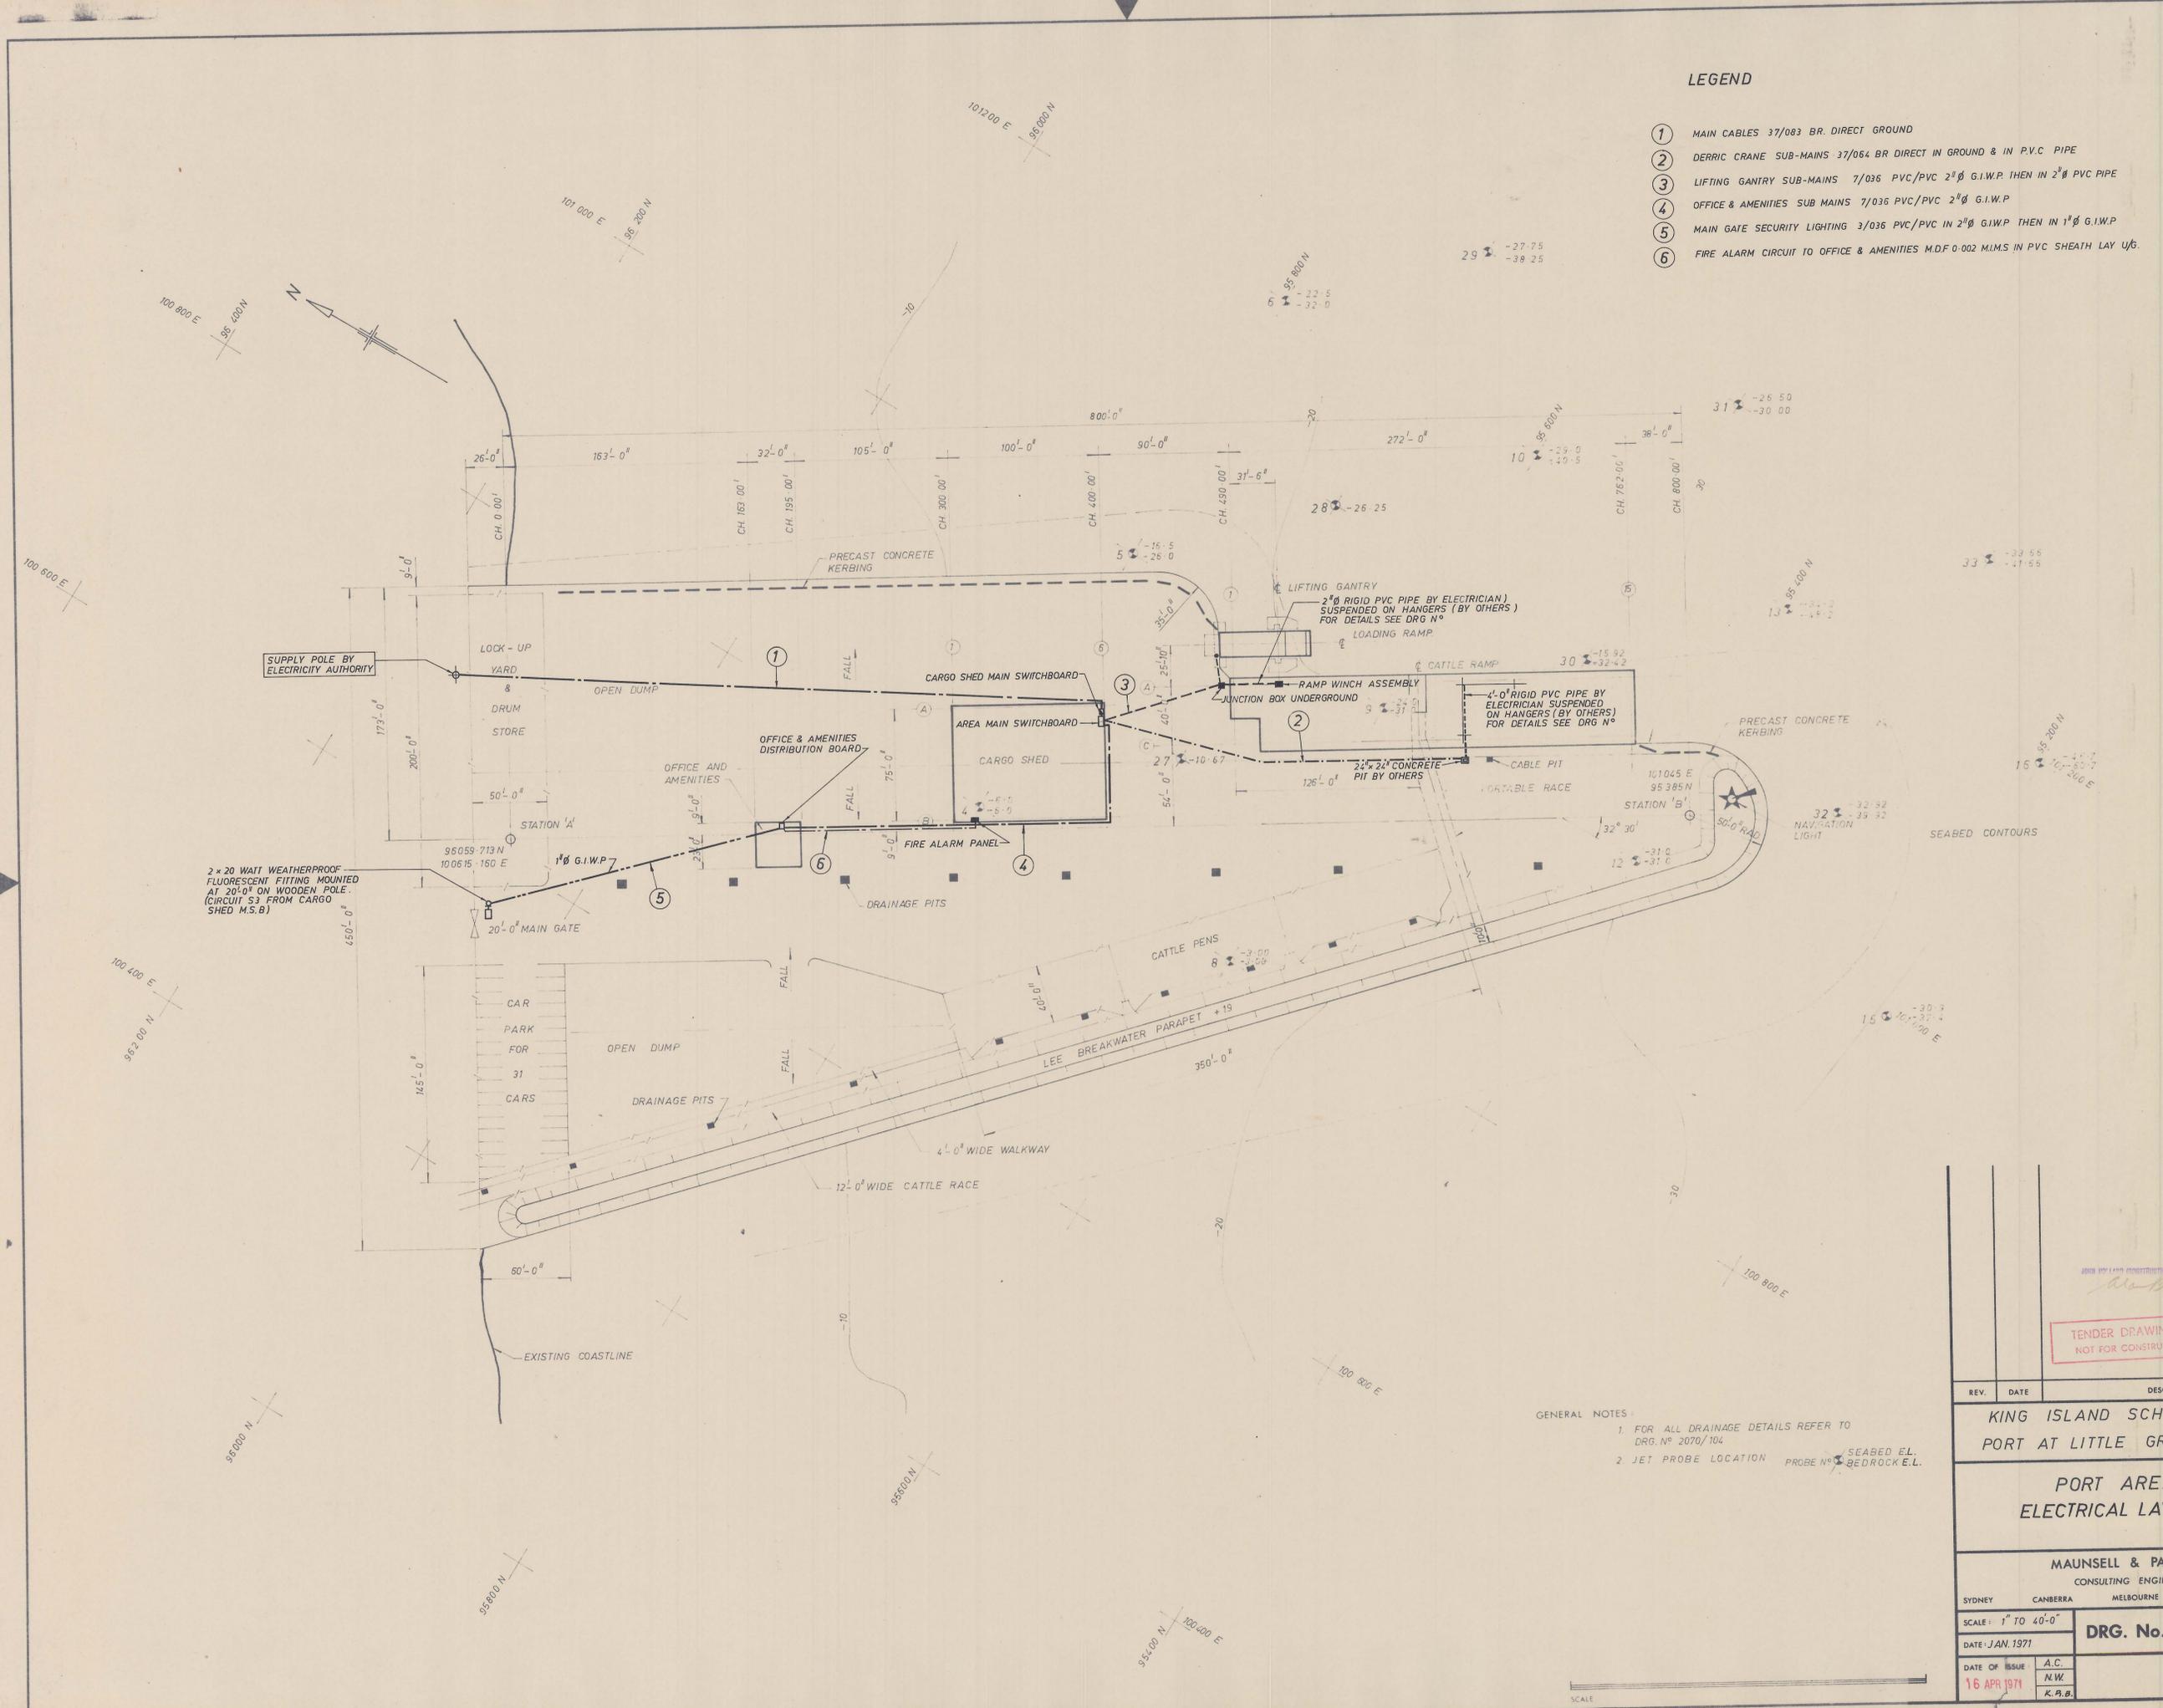

2 x 20 WATT WEATHERPROOF FLUORESCENT FITTING MOUNTED AT 20' 0" ON WOODEN POLE. (CIRCUIT S3 FROM CARGO SHED M.S.B.)

GENERAL NOTES:

- 1. FOR ALL DRAINAGE DETAILS REFER TO DRG. NO 2070/104
- 2. JET PROBE LOCATION PROBE NO. SEABED E.L. BEDROCK E.L.

TENDER DRAWING ONLY
NOT FOR CONSTRUCTION USE

REV.	DATE	DESCRIPTION
KING ISLAND SCHEELITE LTD PORT AT LITTLE GRASSY BAY		
PORT AREA ELECTRICAL LAYOUT		
MAUNSELL & PARTNERS CONSULTING ENGINEERS		
SYDNEY	CANBERRA	MELBOURNE ADELAIDE PERTH
SCALE: 1" TO 40'-0"		DRG. No. 2070/601
DATE OF ISSUE: 16 APR 1971		
DATE OF ISSUE: 16 APR 1971		A.C. M.W. K.A.B.



SCALE