


**Specimen Hill  
(Sn-WO3)**

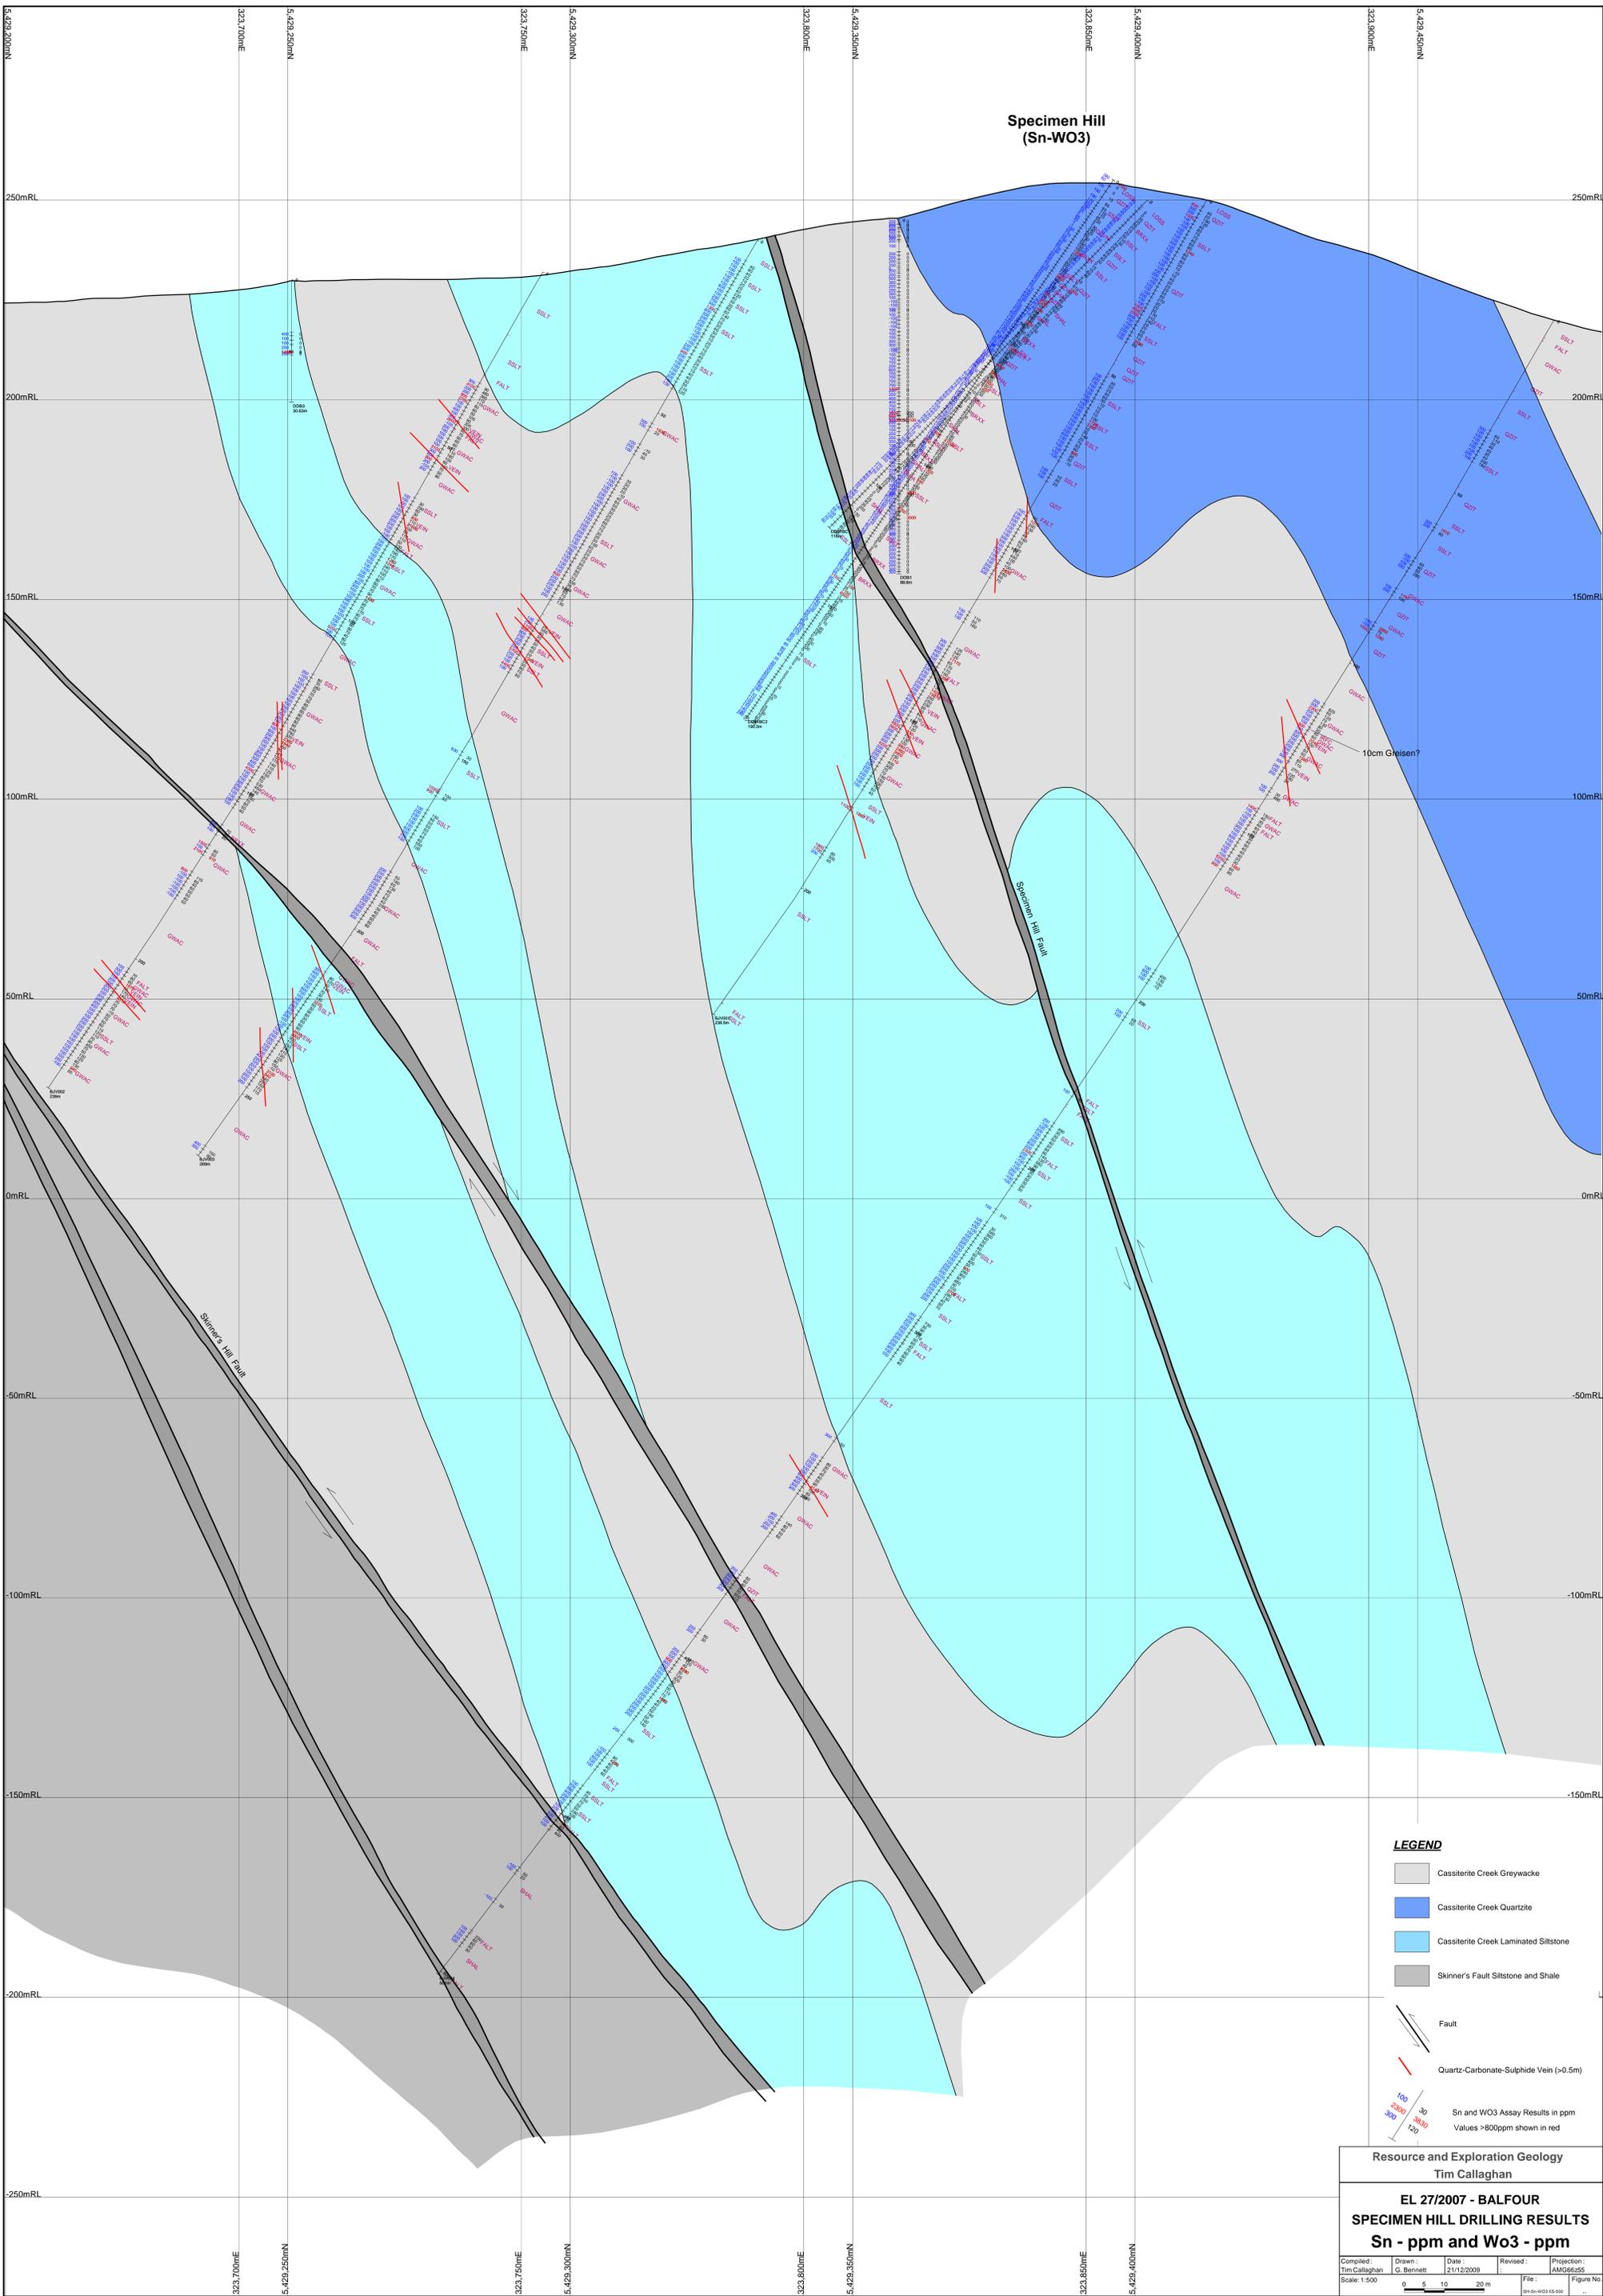

**LEGEND**

- Cassiterite Creek Greywacke
- Cassiterite Creek Quartzite
- Cassiterite Creek Laminated Siltstone
- Skinner's Fault Siltstone and Shale
- Fault
- Quartz-Carbonate-Sulphide Vein (>0.5m)
- Sn and WO3 Assay Results in ppm  
Values >800ppm shown in red

Resource and Exploration Geology  
Tim Callaghan

**EL 27/2007 - BALFOUR  
SPECIMEN HILL DRILLING RESULTS  
Sn - ppm and Wo3 - ppm**

|                            |                      |                         |                      |
|----------------------------|----------------------|-------------------------|----------------------|
| Compiled:<br>Tim Callaghan | Drawn:<br>G. Bennett | Date:<br>21/12/2009     | Revised:<br>AMG66:55 |
| Scale: 1:500               |                      | Projection:<br>AMG66:55 |                      |
| 0 5 10 20 m                |                      | File:<br>Sn-WO3-05-00   | Figure No:<br>...    |