



1917

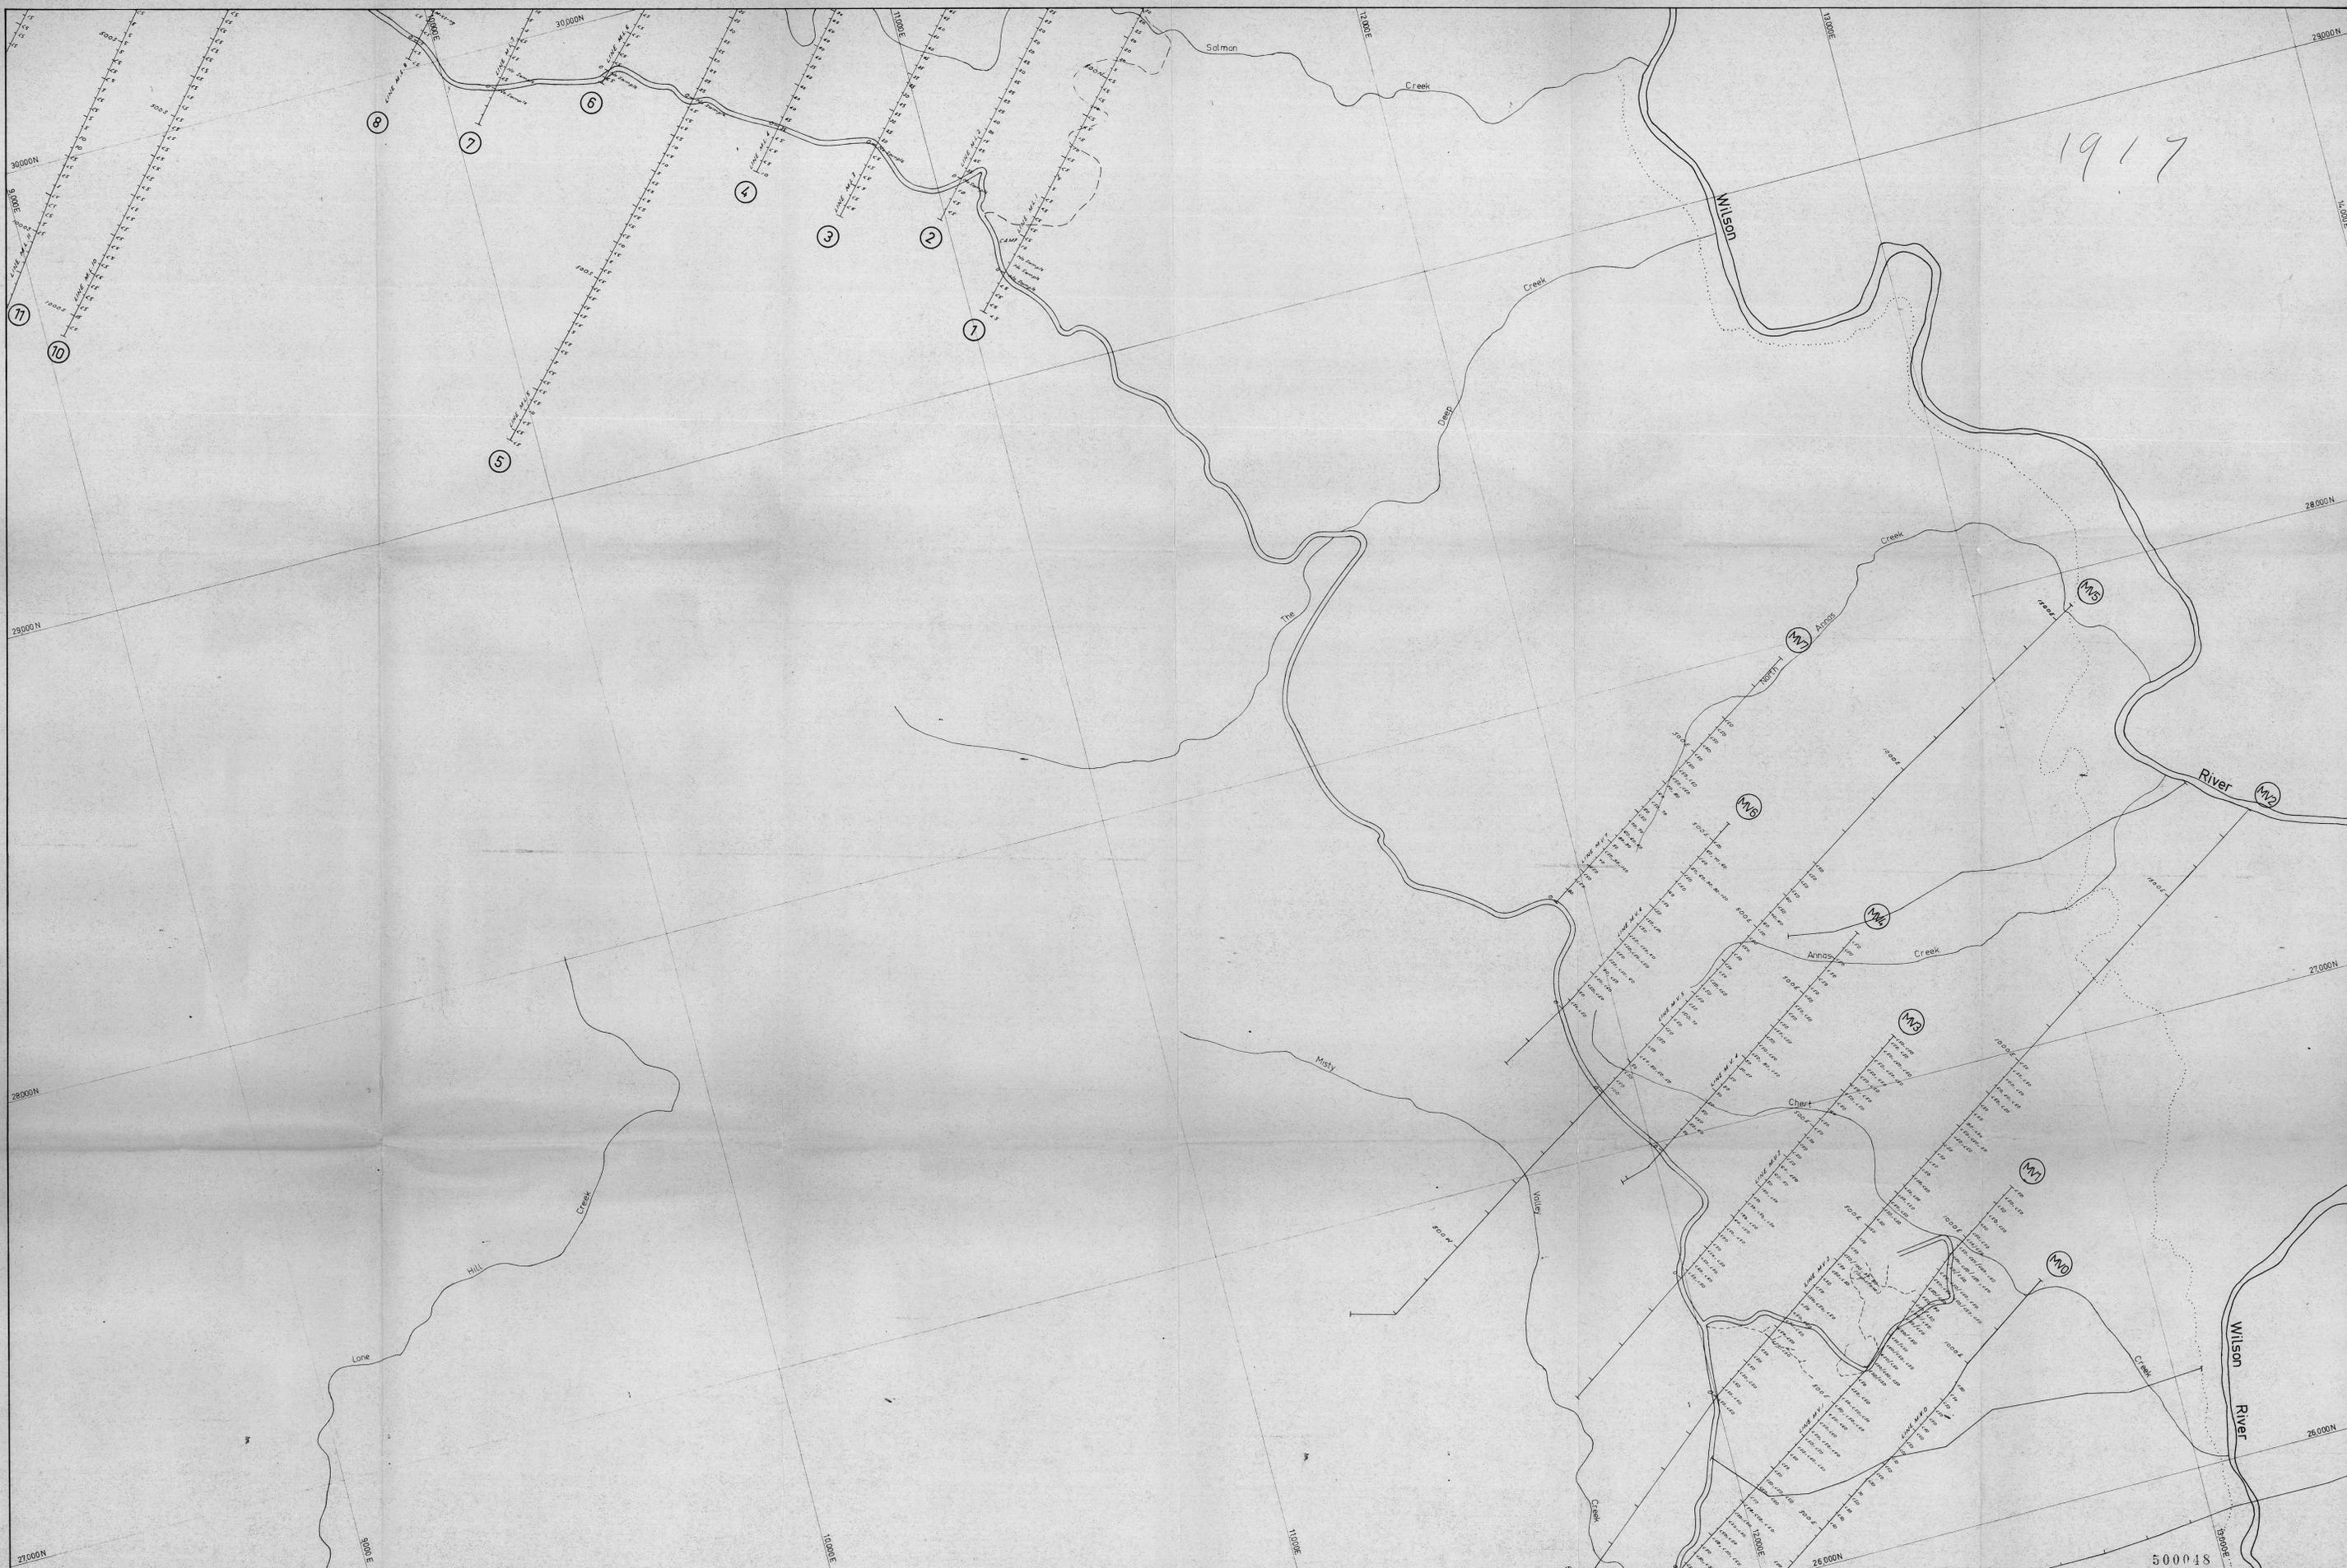

NOTE: 1. The Misty Valley Grid was sampled during the 1973-74 summer. The Mt Lindsay Grid was sampled during the 1974-75 summer. The lower limit of detection was different for the two grids. Misty Valley: 50ppm, Mt. Lindsay: 5ppm.

2. The strong anomaly on MVI 809/900m E was not repeatable and was probably due to contamination.



Strong Anomaly (>100 ppm)
Weak Anomaly (>50 ppm)

KEY
 Road & Walking Track
 Grid Line & Sample Locality
 Original Sample Value with Resampling Values at 0.3, 0.6, 0.9m Depth respectively
 Original Sample Value with Duplicate Sample

| | |
|--------------|--------------|
| CORINNA D1/3 | CORINNA D1/4 |
| CORINNA D3/1 | CORINNA D3/2 |
| CORINNA D3/3 | CORINNA D3/4 |

RENISON LIMITED
CORINNA D3/4
 GEOCHEMICAL SAMPLING / As.
 SCALE: 1:5000 METRES

DRAWN L.A.M.
 TRACED F.C.
 DATE AUG 75
 SCALE 1:5000
 DRAWING No.
 5(b)(iv)