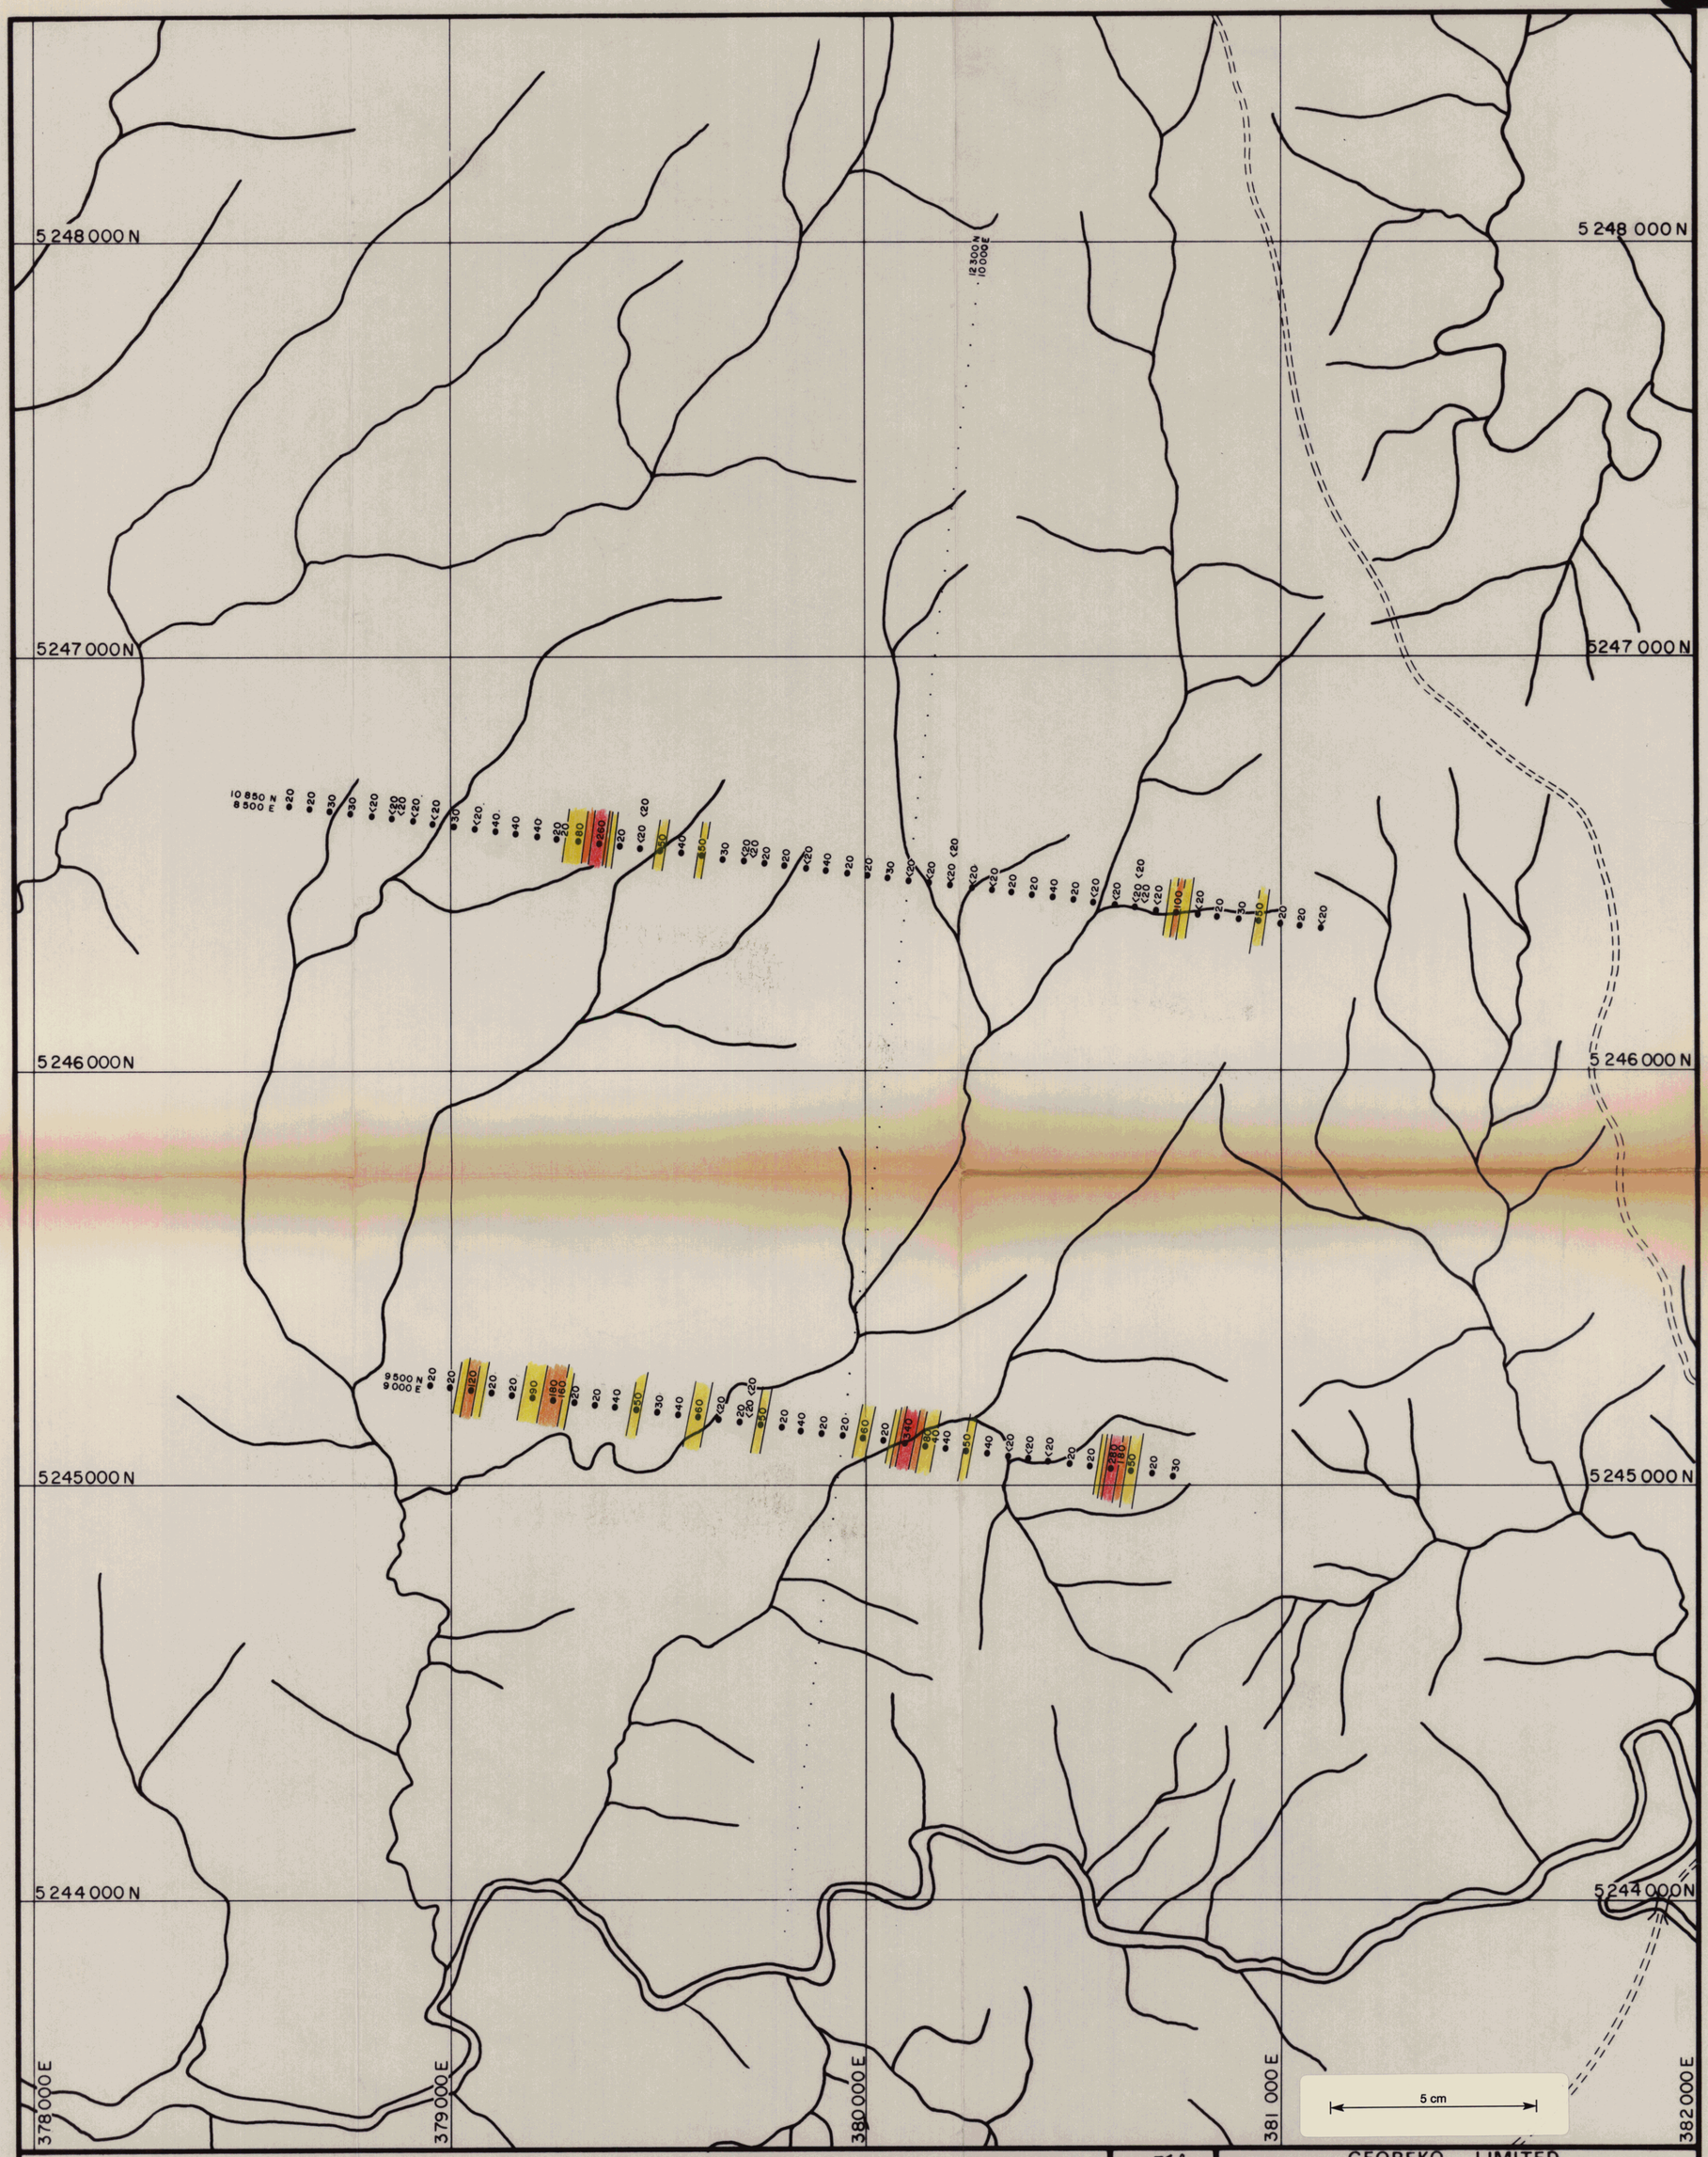

LEGEND

- ● Power auger
- O Hand auger
- · Grid position

● 80 80 40
- 80 ppm Pb original sample.
- 80 ppm Pb repeat and check original sample.
- 40 ppm Pb duplicate sample.

ANALYTICAL METHODS:

Pb by AAS following hot conc. HCL and HCL/HNO_3 leach in latter stages for 1 hour of 0·25g sample.

CONTOUR INTERVAL

Pencil No.	
19-6	50 - 100 ppm
19-10	100 - 200 ppm
19-15	200 - 400 ppm

NOTE

This map has been compiled from enlargements of the Tasmanian Lands Department's 1:15 840 scale topographic machine plots.

DATE JUNE '78
GEOLOGIST C.D.S.
DRAWN J.P.M.
CHECKED

GEOPEKO LIMITED
KING ISLAND GROUP

SCALE 1:10 000

No. KT27/76 V9-4

E.L. 27/76 ELLIOTT BAY, TASMANIA
VOYAGER 9
C-HORIZON GEOCHEMICAL RESULTS
LEAD CONTOURS

051

209252

78-1317