


155

104171

5 cm

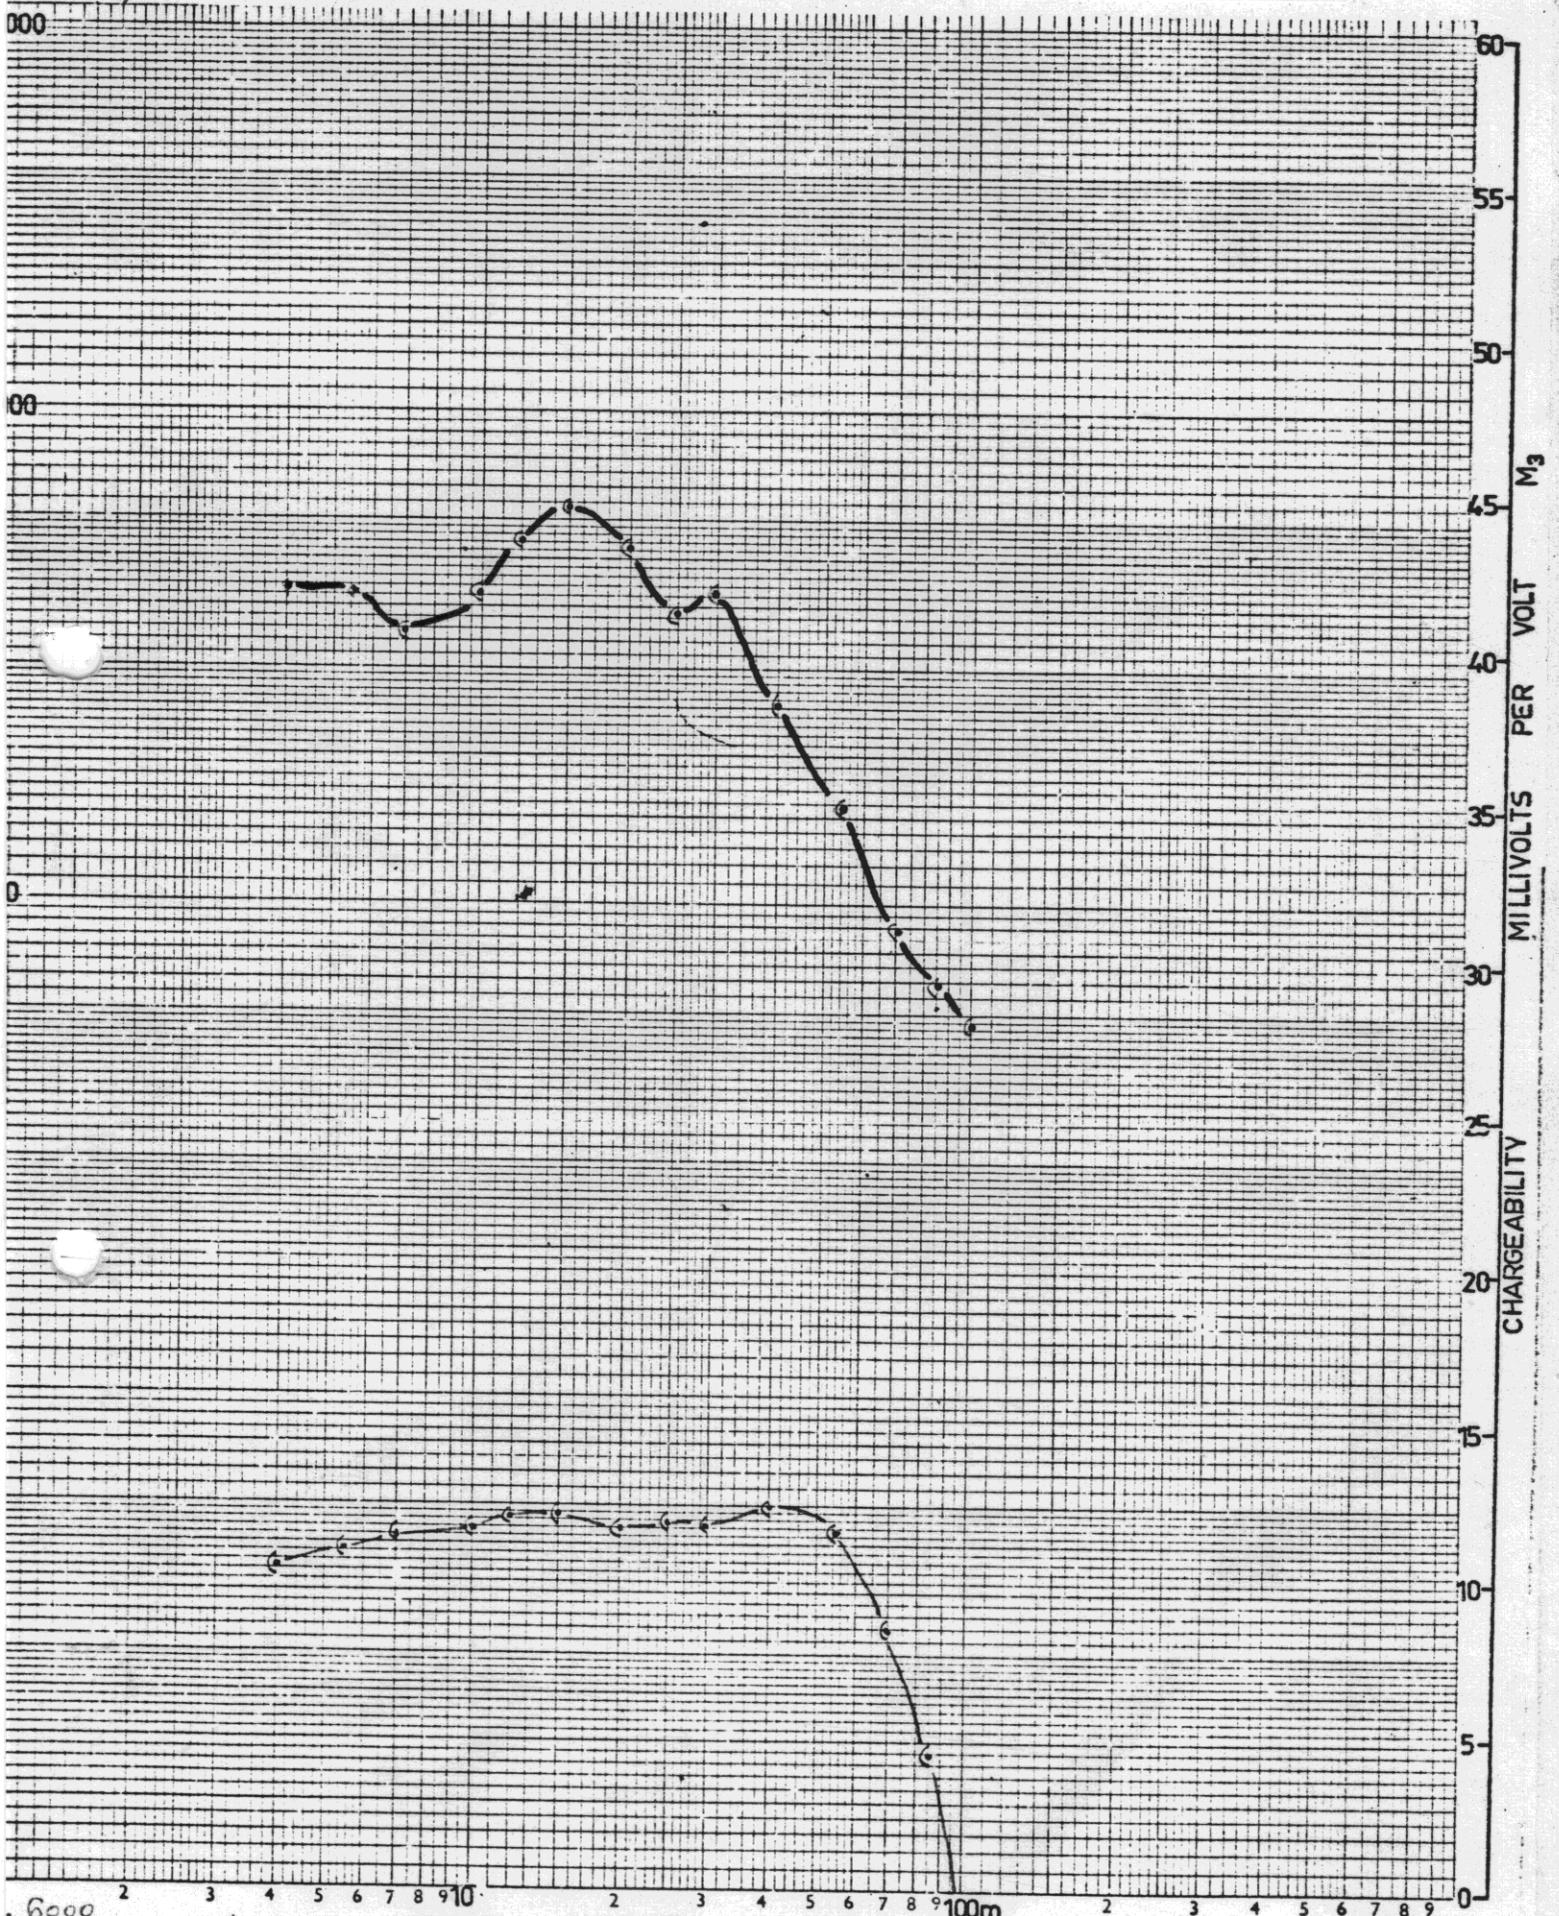

6000
300
18
10
14?
2

Q. 8/c CURRENT ELECTRODE SPACING (metres)

ANCHOR MINE LOTTAH GRID
— I.P. ELECTRICAL SOUNDINGS

TEST N° : KA DATE : 11/3/79
LOCATION : SIN. DOE OPERATOR : S. N. S.
BEARING : SOUTHERN