


104181

5 cm

165

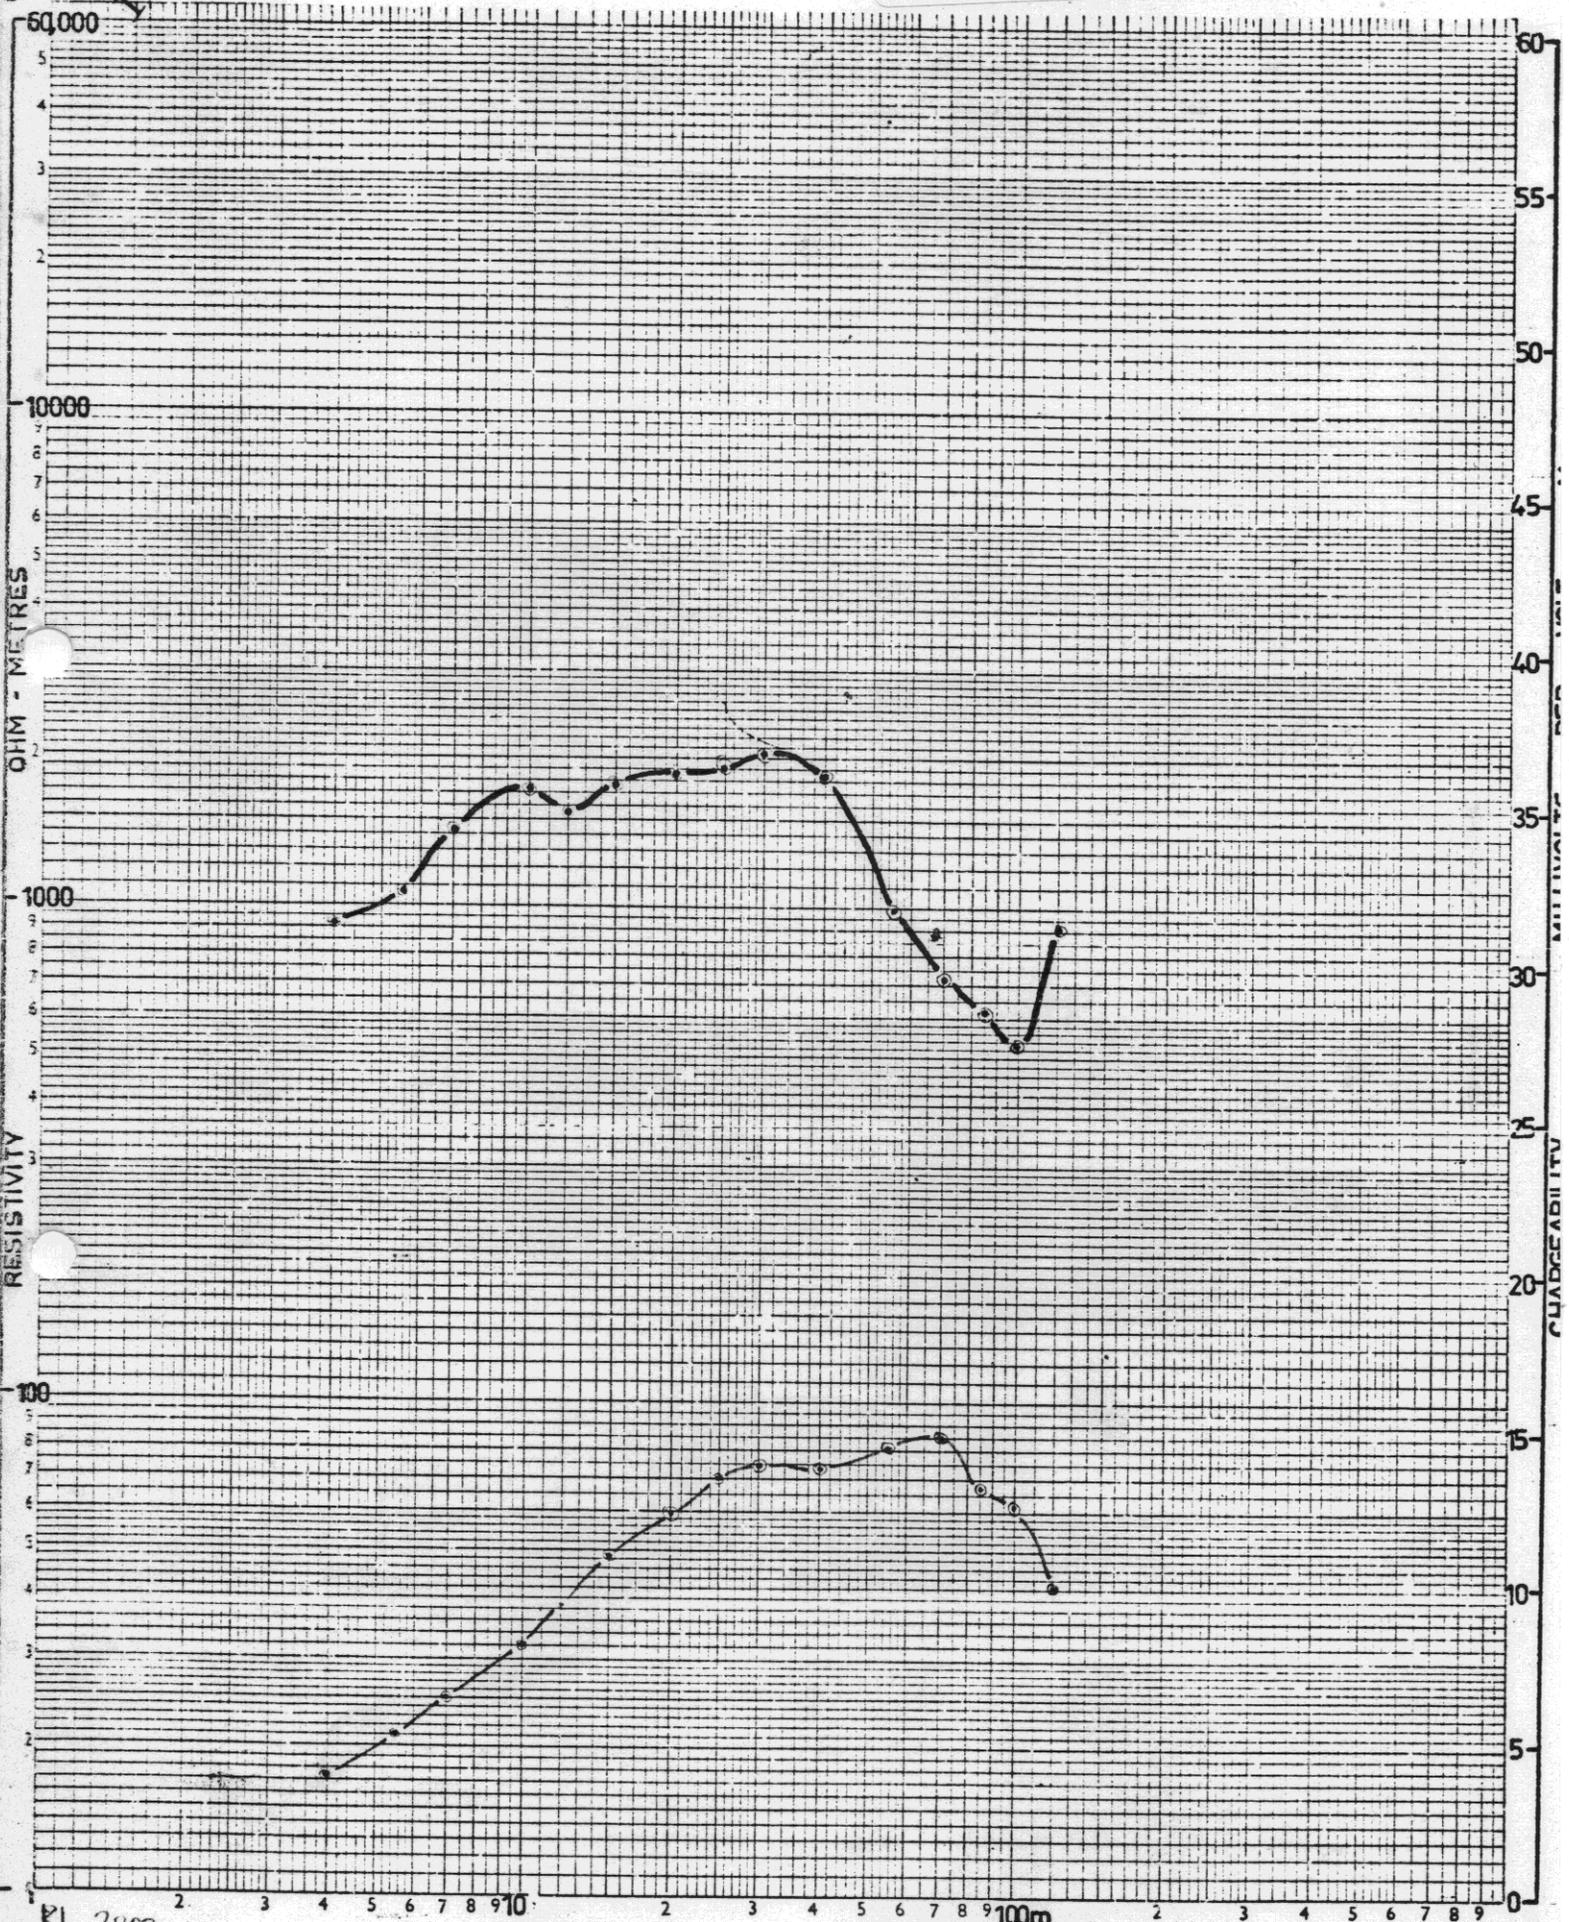

K1. 2700
 K2 100
 DP 30
 MS 4
 A12 18
 DC 4

Q.C.

CURRENT ELECTRODE SPACING (metres)

ANCHOR MINE LOTTAH GRID
 — I.P. ELECTRICAL SOUNDINGS

TEST NO: K14 DATE: 17-8-79
 LOCATION: OPERATOR: J. Webb
 BEARING: Scintrex