


171

104187

5 cm

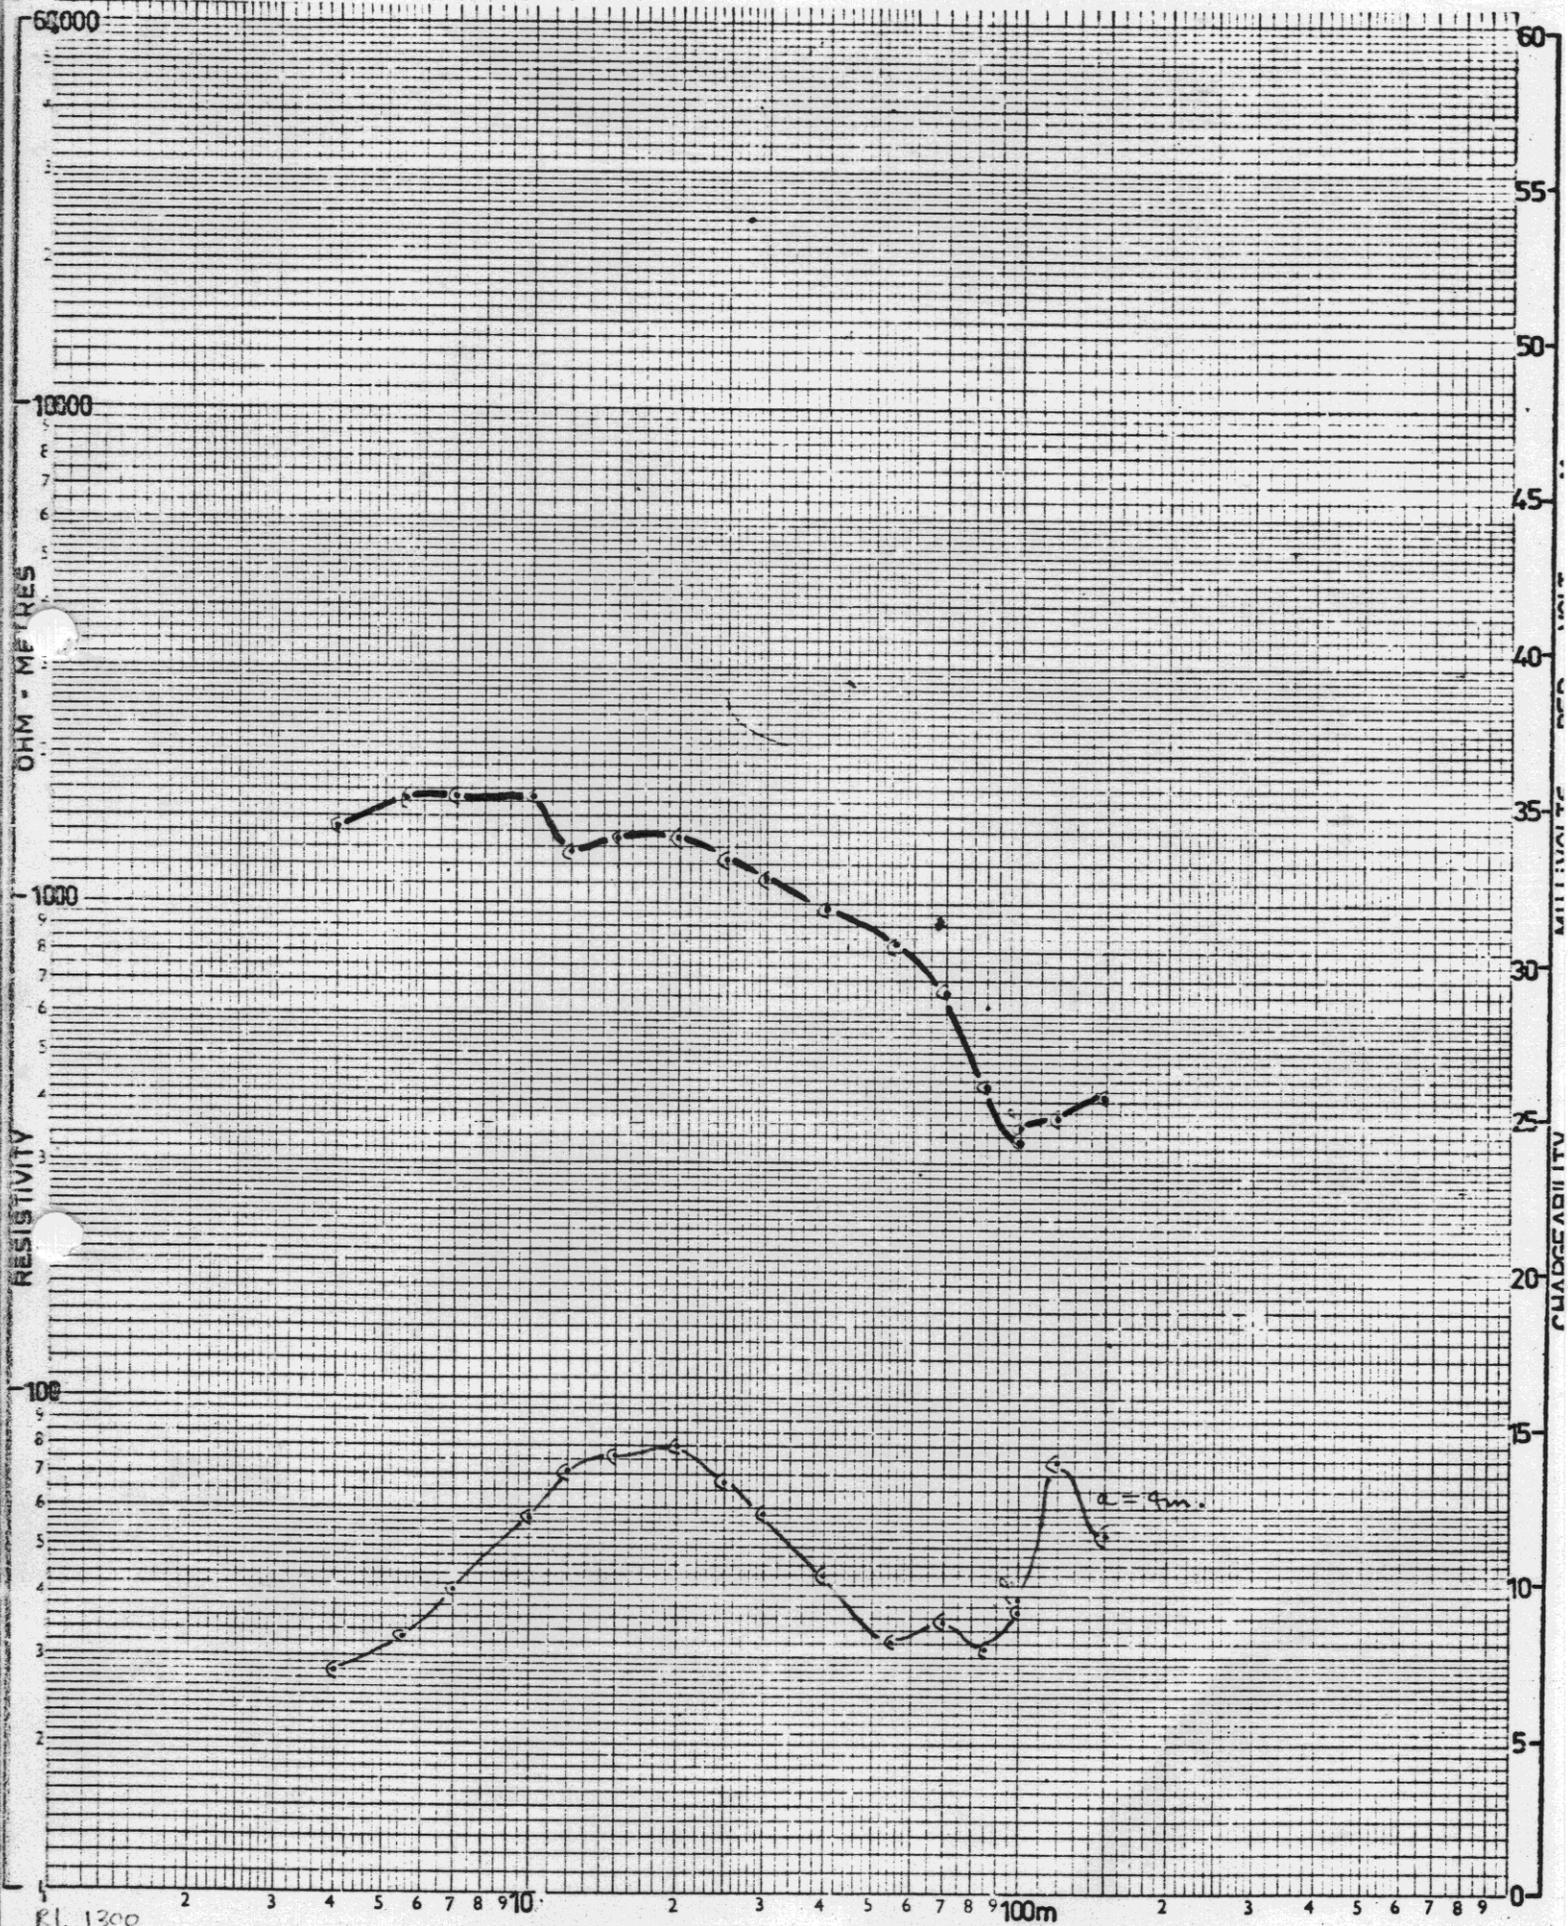

RL 1300  
 R2 50  
 DR 30  
 MS 7  
 M2 18

P.C

CURRENT ELECTRODE SPACING (metres)

ANCHOR MINE LOTTAH GRID

IP ELECTRICAL SOUNDINGS

TEST NO: K20 DATE: 2/8/79  
 LOCATION: OPERATOR: S. J. Webb  
 READING: