


173

104189

5 cm

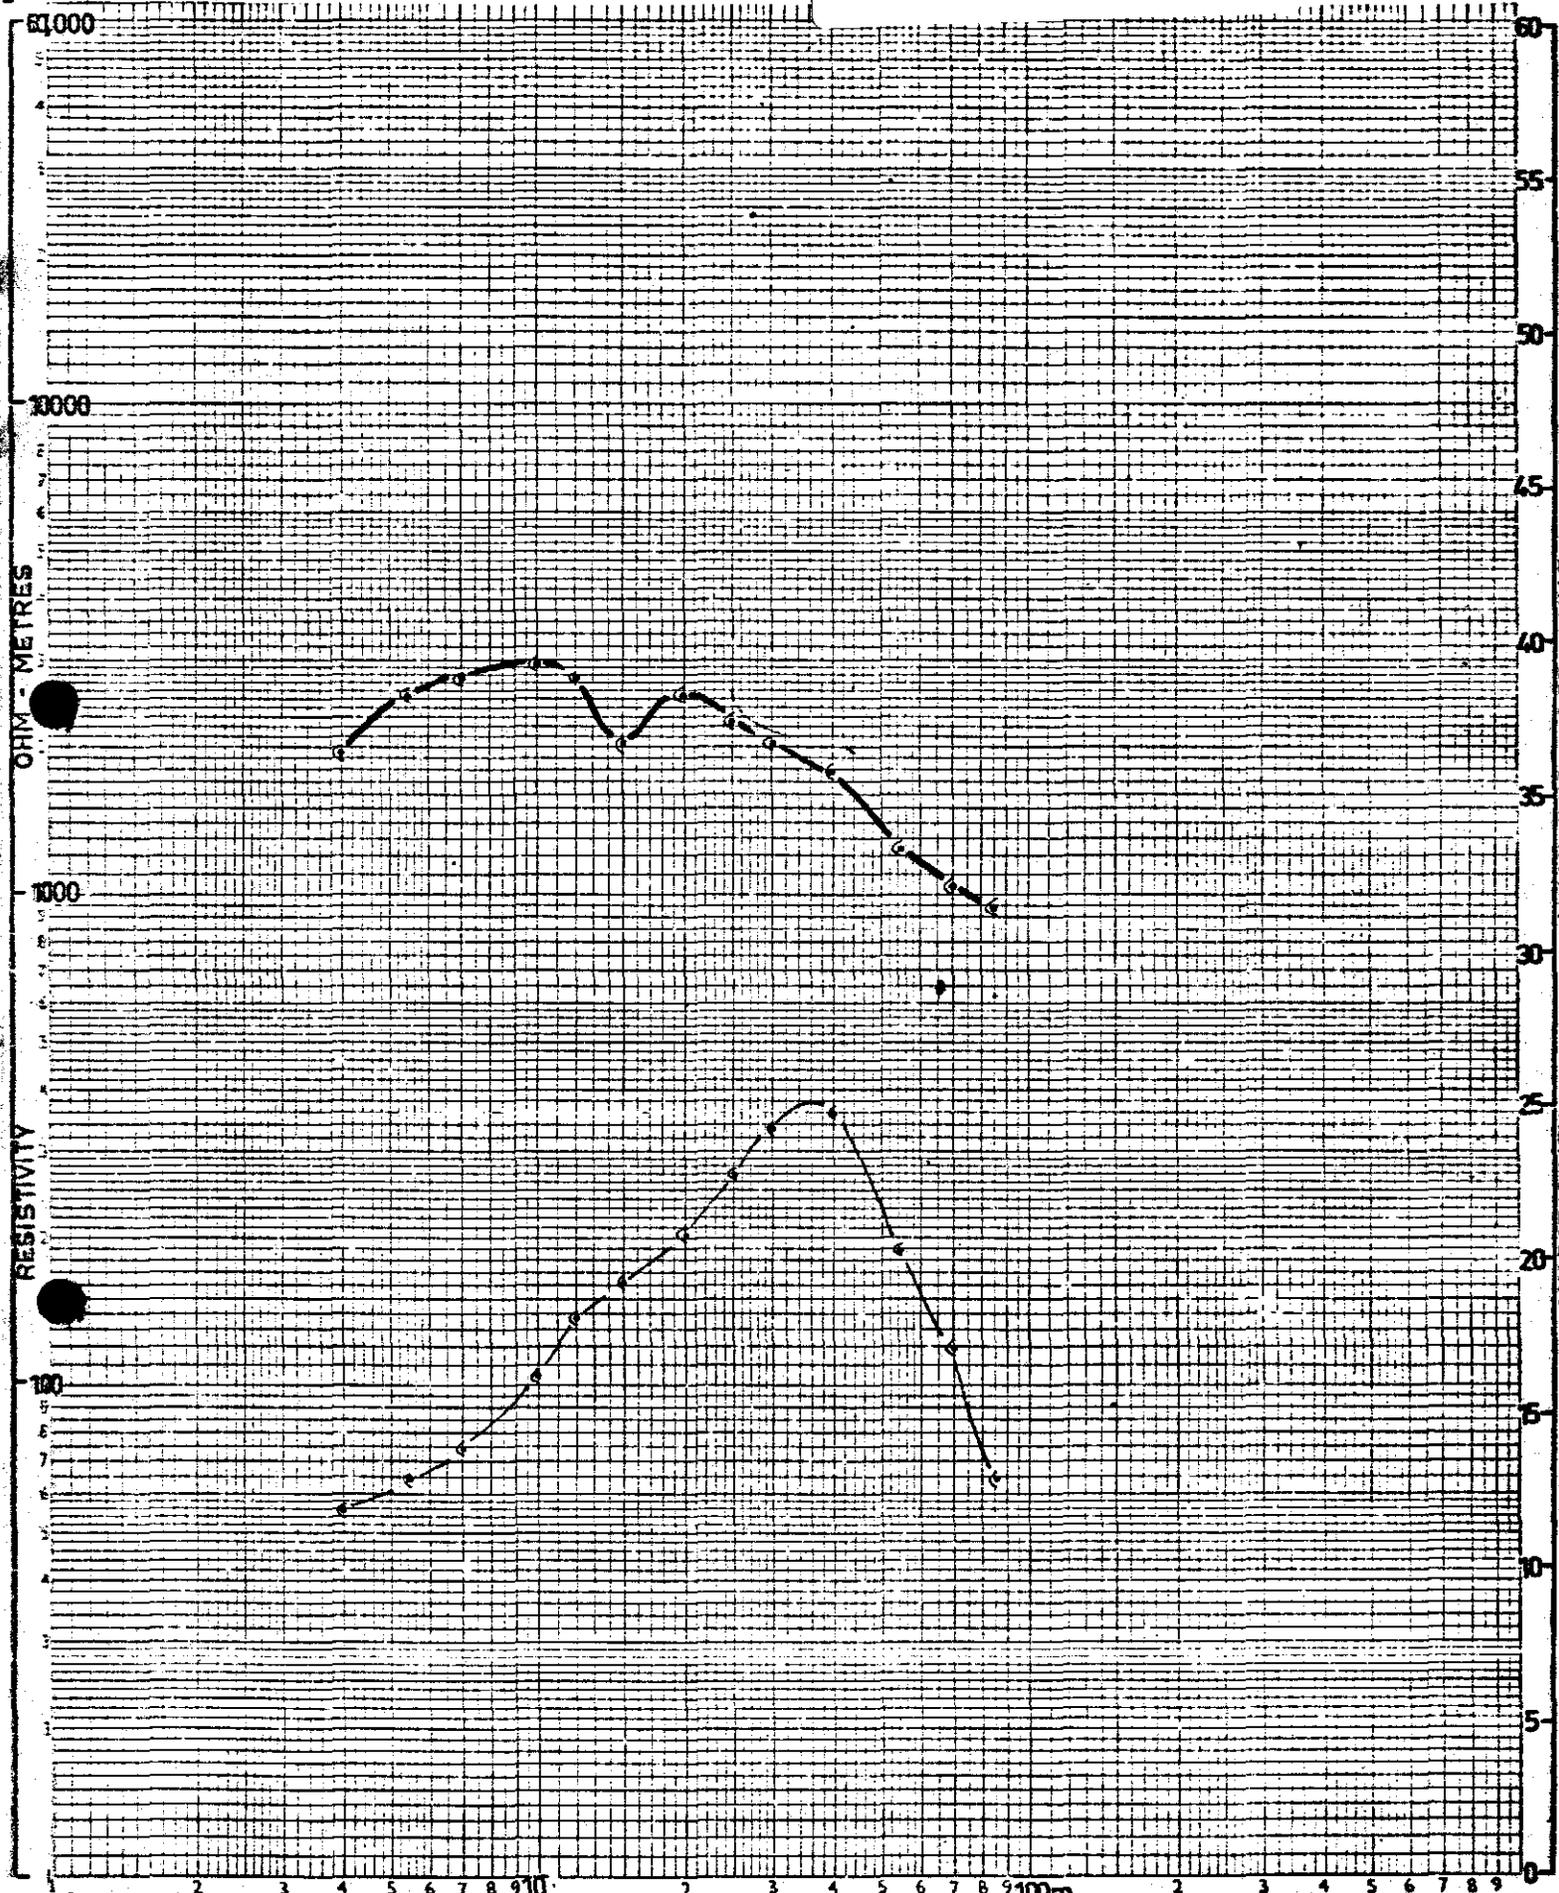

R1. 3000 DC 4
 R2. 750 Q. A.
 DR 20
 MS 12
 M2 4+

CURRENT ELECTRODE SPACING (metres)
 ANCHOR MINE LOTTAH GRID
 I.P. ELECTRICAL SOUNDINGS

TEST N°: K.22 DATE: 21/11/79
 LOCATION: 57N 40RE OPERATOR: D. G. [Signature]
 BEARING: Scribes