


 CENTURY GEOPHYSICAL CORPORATION OF AUSTRALIA		BOREHOLE R091	DATE 19-04-82																																																																																																																																																																																										
COMPANY C.S.R.		UNIT/OPERATOR 8038 CREWS	FIELD OFFICE BRISBANE																																																																																																																																																																																										
BOREHOLE R091		EQUIPMENT DATA																																																																																																																																																																																											
AREA LAUNCESTON	ELEVATION TAS.	<table border="1"> <tr> <td>PROBE MODEL</td> <td>788</td> <td>789</td> <td>790</td> <td>791</td> <td>792</td> </tr> <tr> <td>PROBE DIAMETER</td> <td>12.0mm</td> <td>12.0mm</td> <td>12.0mm</td> <td>12.0mm</td> <td>12.0mm</td> </tr> <tr> <td>DETECTOR TYPE</td> <td>NI</td> <td>NI</td> <td>NI</td> <td>NI</td> <td>NI</td> </tr> <tr> <td>DETECTOR SIZE</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> </tr> <tr> <td>STD. FACTOR</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>STD. DEVIATION</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>CALIB. MODEL LOC.</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>CALIB. DATE</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>K FACTOR $\times 10^{-4}$</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>DEVIATION μmm</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>TEST READING</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>WATER FACTOR</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>CASING FACTOR</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>DETECTOR TYPE</td> <td>NI</td> <td>NI</td> <td>NI</td> <td>NI</td> <td>NI</td> </tr> <tr> <td>DETECTOR SIZE</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> <td>21mm x 116mm</td> </tr> <tr> <td>SOURCE TYPE</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SOURCE NO.</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SOURCE STRENGTH</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SOURCE SPACING</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>DETECTOR TYPE</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>DETECTOR SIZE</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SOURCE TYPE</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SOURCE NO.</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SOURCE STRENGTH</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SOURCE SPACING</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SNGL. PT. RESISTANCE</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>RESISTIVITY</td> <td>15cm focused</td> <td>2.5m focused</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>SELF POTENTIAL</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>TEMPERATURE</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>DEVIATION</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> <tr> <td>CALIB.</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> <td>---</td> </tr> </table>		PROBE MODEL	788	789	790	791	792	PROBE DIAMETER	12.0mm	12.0mm	12.0mm	12.0mm	12.0mm	DETECTOR TYPE	NI	NI	NI	NI	NI	DETECTOR SIZE	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm	STD. FACTOR	---	---	---	---	---	STD. DEVIATION	---	---	---	---	---	CALIB. MODEL LOC.	---	---	---	---	---	CALIB. DATE	---	---	---	---	---	K FACTOR $\times 10^{-4}$	---	---	---	---	---	DEVIATION μ mm	---	---	---	---	---	TEST READING	---	---	---	---	---	WATER FACTOR	---	---	---	---	---	CASING FACTOR	---	---	---	---	---	DETECTOR TYPE	NI	NI	NI	NI	NI	DETECTOR SIZE	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm	SOURCE TYPE	---	---	---	---	---	SOURCE NO.	---	---	---	---	---	SOURCE STRENGTH	---	---	---	---	---	SOURCE SPACING	---	---	---	---	---	DETECTOR TYPE	---	---	---	---	---	DETECTOR SIZE	---	---	---	---	---	SOURCE TYPE	---	---	---	---	---	SOURCE NO.	---	---	---	---	---	SOURCE STRENGTH	---	---	---	---	---	SOURCE SPACING	---	---	---	---	---	SNGL. PT. RESISTANCE	---	---	---	---	---	RESISTIVITY	15cm focused	2.5m focused	---	---	---	SELF POTENTIAL	---	---	---	---	---	TEMPERATURE	---	---	---	---	---	DEVIATION	---	---	---	---	---	CALIB.	---	---	---	---	---
PROBE MODEL	788	789	790	791	792																																																																																																																																																																																								
PROBE DIAMETER	12.0mm	12.0mm	12.0mm	12.0mm	12.0mm																																																																																																																																																																																								
DETECTOR TYPE	NI	NI	NI	NI	NI																																																																																																																																																																																								
DETECTOR SIZE	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm																																																																																																																																																																																								
STD. FACTOR	---	---	---	---	---																																																																																																																																																																																								
STD. DEVIATION	---	---	---	---	---																																																																																																																																																																																								
CALIB. MODEL LOC.	---	---	---	---	---																																																																																																																																																																																								
CALIB. DATE	---	---	---	---	---																																																																																																																																																																																								
K FACTOR $\times 10^{-4}$	---	---	---	---	---																																																																																																																																																																																								
DEVIATION μ mm	---	---	---	---	---																																																																																																																																																																																								
TEST READING	---	---	---	---	---																																																																																																																																																																																								
WATER FACTOR	---	---	---	---	---																																																																																																																																																																																								
CASING FACTOR	---	---	---	---	---																																																																																																																																																																																								
DETECTOR TYPE	NI	NI	NI	NI	NI																																																																																																																																																																																								
DETECTOR SIZE	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm	21mm x 116mm																																																																																																																																																																																								
SOURCE TYPE	---	---	---	---	---																																																																																																																																																																																								
SOURCE NO.	---	---	---	---	---																																																																																																																																																																																								
SOURCE STRENGTH	---	---	---	---	---																																																																																																																																																																																								
SOURCE SPACING	---	---	---	---	---																																																																																																																																																																																								
DETECTOR TYPE	---	---	---	---	---																																																																																																																																																																																								
DETECTOR SIZE	---	---	---	---	---																																																																																																																																																																																								
SOURCE TYPE	---	---	---	---	---																																																																																																																																																																																								
SOURCE NO.	---	---	---	---	---																																																																																																																																																																																								
SOURCE STRENGTH	---	---	---	---	---																																																																																																																																																																																								
SOURCE SPACING	---	---	---	---	---																																																																																																																																																																																								
SNGL. PT. RESISTANCE	---	---	---	---	---																																																																																																																																																																																								
RESISTIVITY	15cm focused	2.5m focused	---	---	---																																																																																																																																																																																								
SELF POTENTIAL	---	---	---	---	---																																																																																																																																																																																								
TEMPERATURE	---	---	---	---	---																																																																																																																																																																																								
DEVIATION	---	---	---	---	---																																																																																																																																																																																								
CALIB.	---	---	---	---	---																																																																																																																																																																																								
HOLEDATA																																																																																																																																																																																													
TOTAL DEPTH - DRILLER 48M		BIT SIZE 12CM																																																																																																																																																																																											
TOTAL DEPTH - LOGGER 47.0M		CASING - TYPE & SIZE ---																																																																																																																																																																																											
TOTAL METERAGE LOGGED 47.0M		CASING DEPTH ---																																																																																																																																																																																											
LOGGING SPEED 9M/MIN.		BOREHOLE FLUID H2O																																																																																																																																																																																											
REFERENCE LEVEL G.L.		FLUID RESISTIVITY --- Ω CM																																																																																																																																																																																											
PROBE NO. 9032A-901		SOFTWARE LEVEL V9LI																																																																																																																																																																																											
TAPE 31 TRACK 3		SCALE SELECTION ☒ OPERATOR ☐ CLIENT																																																																																																																																																																																											
REMARKS																																																																																																																																																																																													

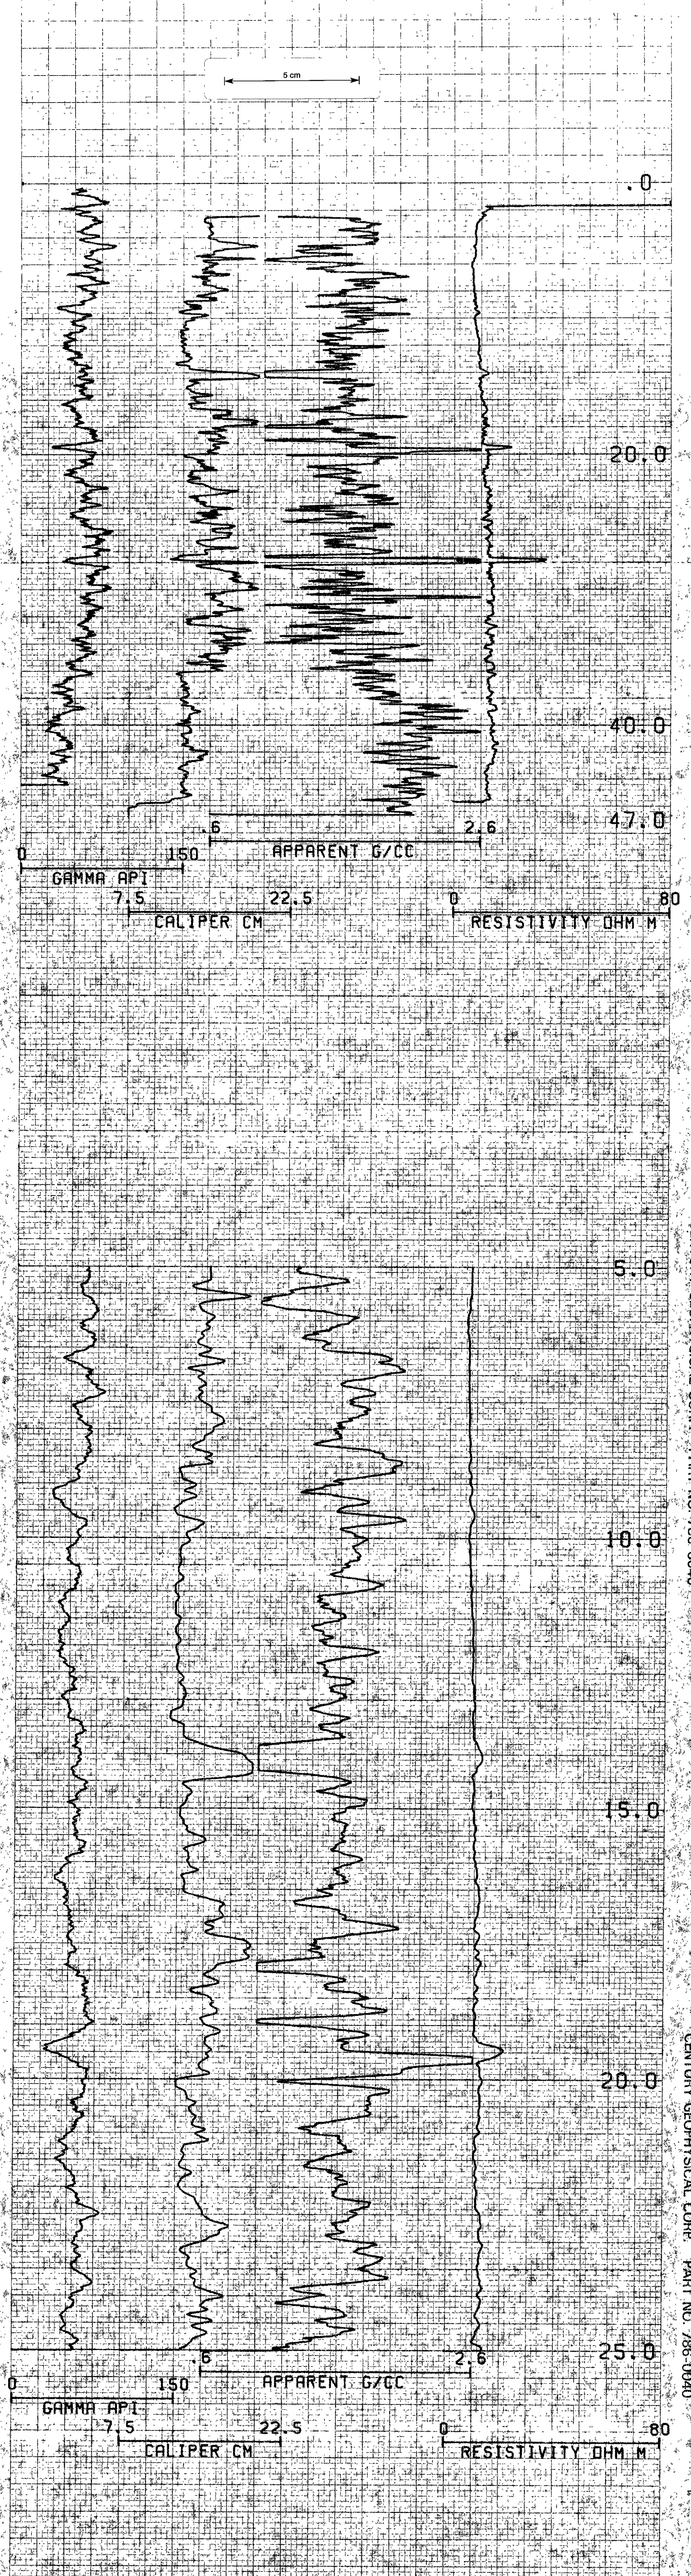

COMPU LOG V8L2 PLOT 04-19-82
 R091
 C.S.R.
 LAUNCESTON
 HOLE DIAMETER : 12.0
 PROBE # 9032A - 901
 SENSOR #4 CAL STD CPS = 4625
 SENSOR #4 CAL RUN CPS = 4600
 SENSOR #4 CAL BIAS = 0
 DATA V9LI TRUCK # 8038
 GREG CREWS APPL #1030 K

CENTURY GEOPHYSICAL CORP. PART NO. 786-0040

CENTURY GEOPHYSICAL CORP. PART NO. 786-0040

CENTURY GEOPHYSICAL CORP. PART NO. 786-0040

CENTURY GEOPHYSICAL CORP. PART NO. 786-0040

82-1766, Vol. 60F6

111

771584