





Sample No.	%Sn	%SSn	%Ag	%Zn	%Pb	%Cu	%W	%S	%Sb
001	0.8	0.01	0.03	0.07	0.08	5	0.01	0.89	FACE
002	1.3	0.01	0.02	0.19	0.12	0.01	1.44		
003	0.4	0.01	0.02	0.05	0.01	2	0.01	0.53	
004	0.4	0.01	0.02	0.03	0.01	2	0.01	0.28	
005	1.7	0.01	0.05	0.04	0.90	4	0.01	0.17	
006	0.9	0.01	0.04	0.01	0.39	2	0.01	0.04	
007	0.5	0.01	0.03	0.02	0.02	2	0.01	0.06	
008	0.1	0.01	0.02	0.01	0.01	1	0.01	0.02	
009	0.6	0.01	0.04	0.03	0.03	4	0.01	0.12	
010	0.5	0.01	0.03	0.01	0.01	3	0.01	0.10	
011	0.5	0.01	0.02	0.07	0.01	7	0.01	0.12	
012	0.4	0.01	0.02	0.08	0.01	8	0.01	0.04	
013	0.8	0.01	0.03	0.04	0.01	10	0.01	0.04	
014	0.6	0.01	0.03	0.11	0.01	45	0.01	0.03	
015	1.3	0.01	0.05	0.04	0.02	69	0.01	0.05	

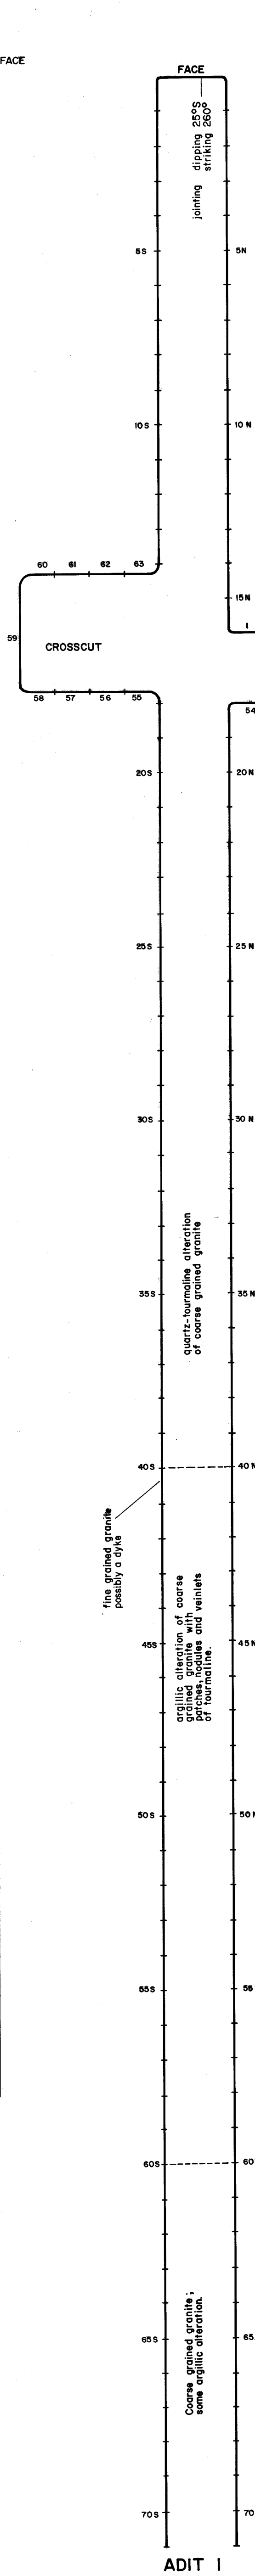

Sample No.	%Sn	%SSn	%Ag	%Zn	%Pb	%Cu	%W	%S	%Sb
016	0.39	0.01	4	0.02	0.04	0.03	0.01	1.2	0.01
017	0.68	0.02	8	0.07	0.11	0.03	0.01	1.3	0.01
018	0.31	0.01	5	0.02	0.02	0.02	0.01	0.6	0.01
019	0.17	0.01	11	0.08	0.02	0.05	0.01	2.4	0.01
020	0.06	0.01	11	0.02	0.01	0.03	0.01	0.7	0.01
021	0.04	0.01	1	0.05	0.03	0.03	0.01	0.9	0.01
022	0.05	0.01	41	0.01	0.01	0.03	0.01	0.6	0.01
023	0.09	0.01	8	0.03	0.06	0.02	0.01	2.7	0.01
024	0.13	0.01	5	0.01	0.03	0.02	0.01	1.0	0.01
025	0.07	0.01	10	0.01	0.03	0.03	0.01	1.5	0.01
026	0.07	0.01	16	0.06	0.01	0.04	0.01	1.6	0.01
027	0.11	0.01	41	0.06	0.10	0.06	0.01	4.5	0.01
028	0.05	0.01	22	0.70	0.05	0.06	0.01	1.8	0.01
029	0.18	0.01	59	0.22	0.18	0.03	0.01	1.7	0.03
030	0.04	0.01	7	0.20	0.10	0.30	0.01	0.8	0.02

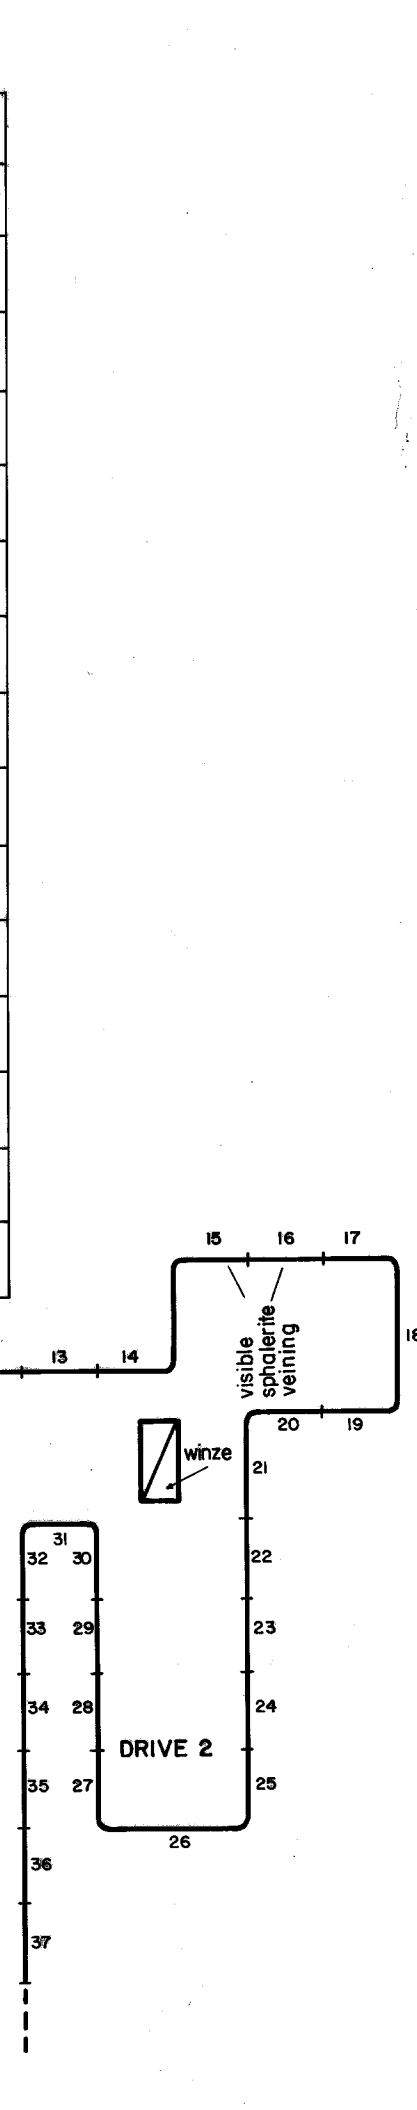


Sample No.	%Sn	%SSn	%Ag	%Zn	%Pb	%Cu	%W	%S	%Sb
031	0.04	0.01	32	0.02	0.51	0.03	0.01	0.5	0.02
032	0.02	0.01	16	0.01	0.53	0.02	0.04	0.2	0.02
033	0.03	0.01	50	0.02	3.23	0.02	0.06	1.4	0.04
034	0.05	0.01	10	0.06	0.17	0.04	0.03	1.6	0.01
035	0.09	0.01	4	0.06	0.07	0.02	0.01	1.1	0.01
036	0.09	0.01	2	0.01	0.02	0.02	0.01	0.7	0.01
037	0.11	0.01	2	0.01	0.05	0.02	0.01	0.6	0.01
038	0.03	0.01	2	0.01	0.05	0.03	0.01	0.5	0.01
039	0.02	0.01	2	0.01	0.01	0.02	0.01	0.2	0.01
040	0.02	0.01	4	0.01	0.13	0.03	0.01	0.7	0.01
041	0.02	0.01	1	0.12	0.04	0.02	0.01	0.4	0.01
042	0.04	0.01	1	0.07	0.01	0.02	0.01	1.0	0.01

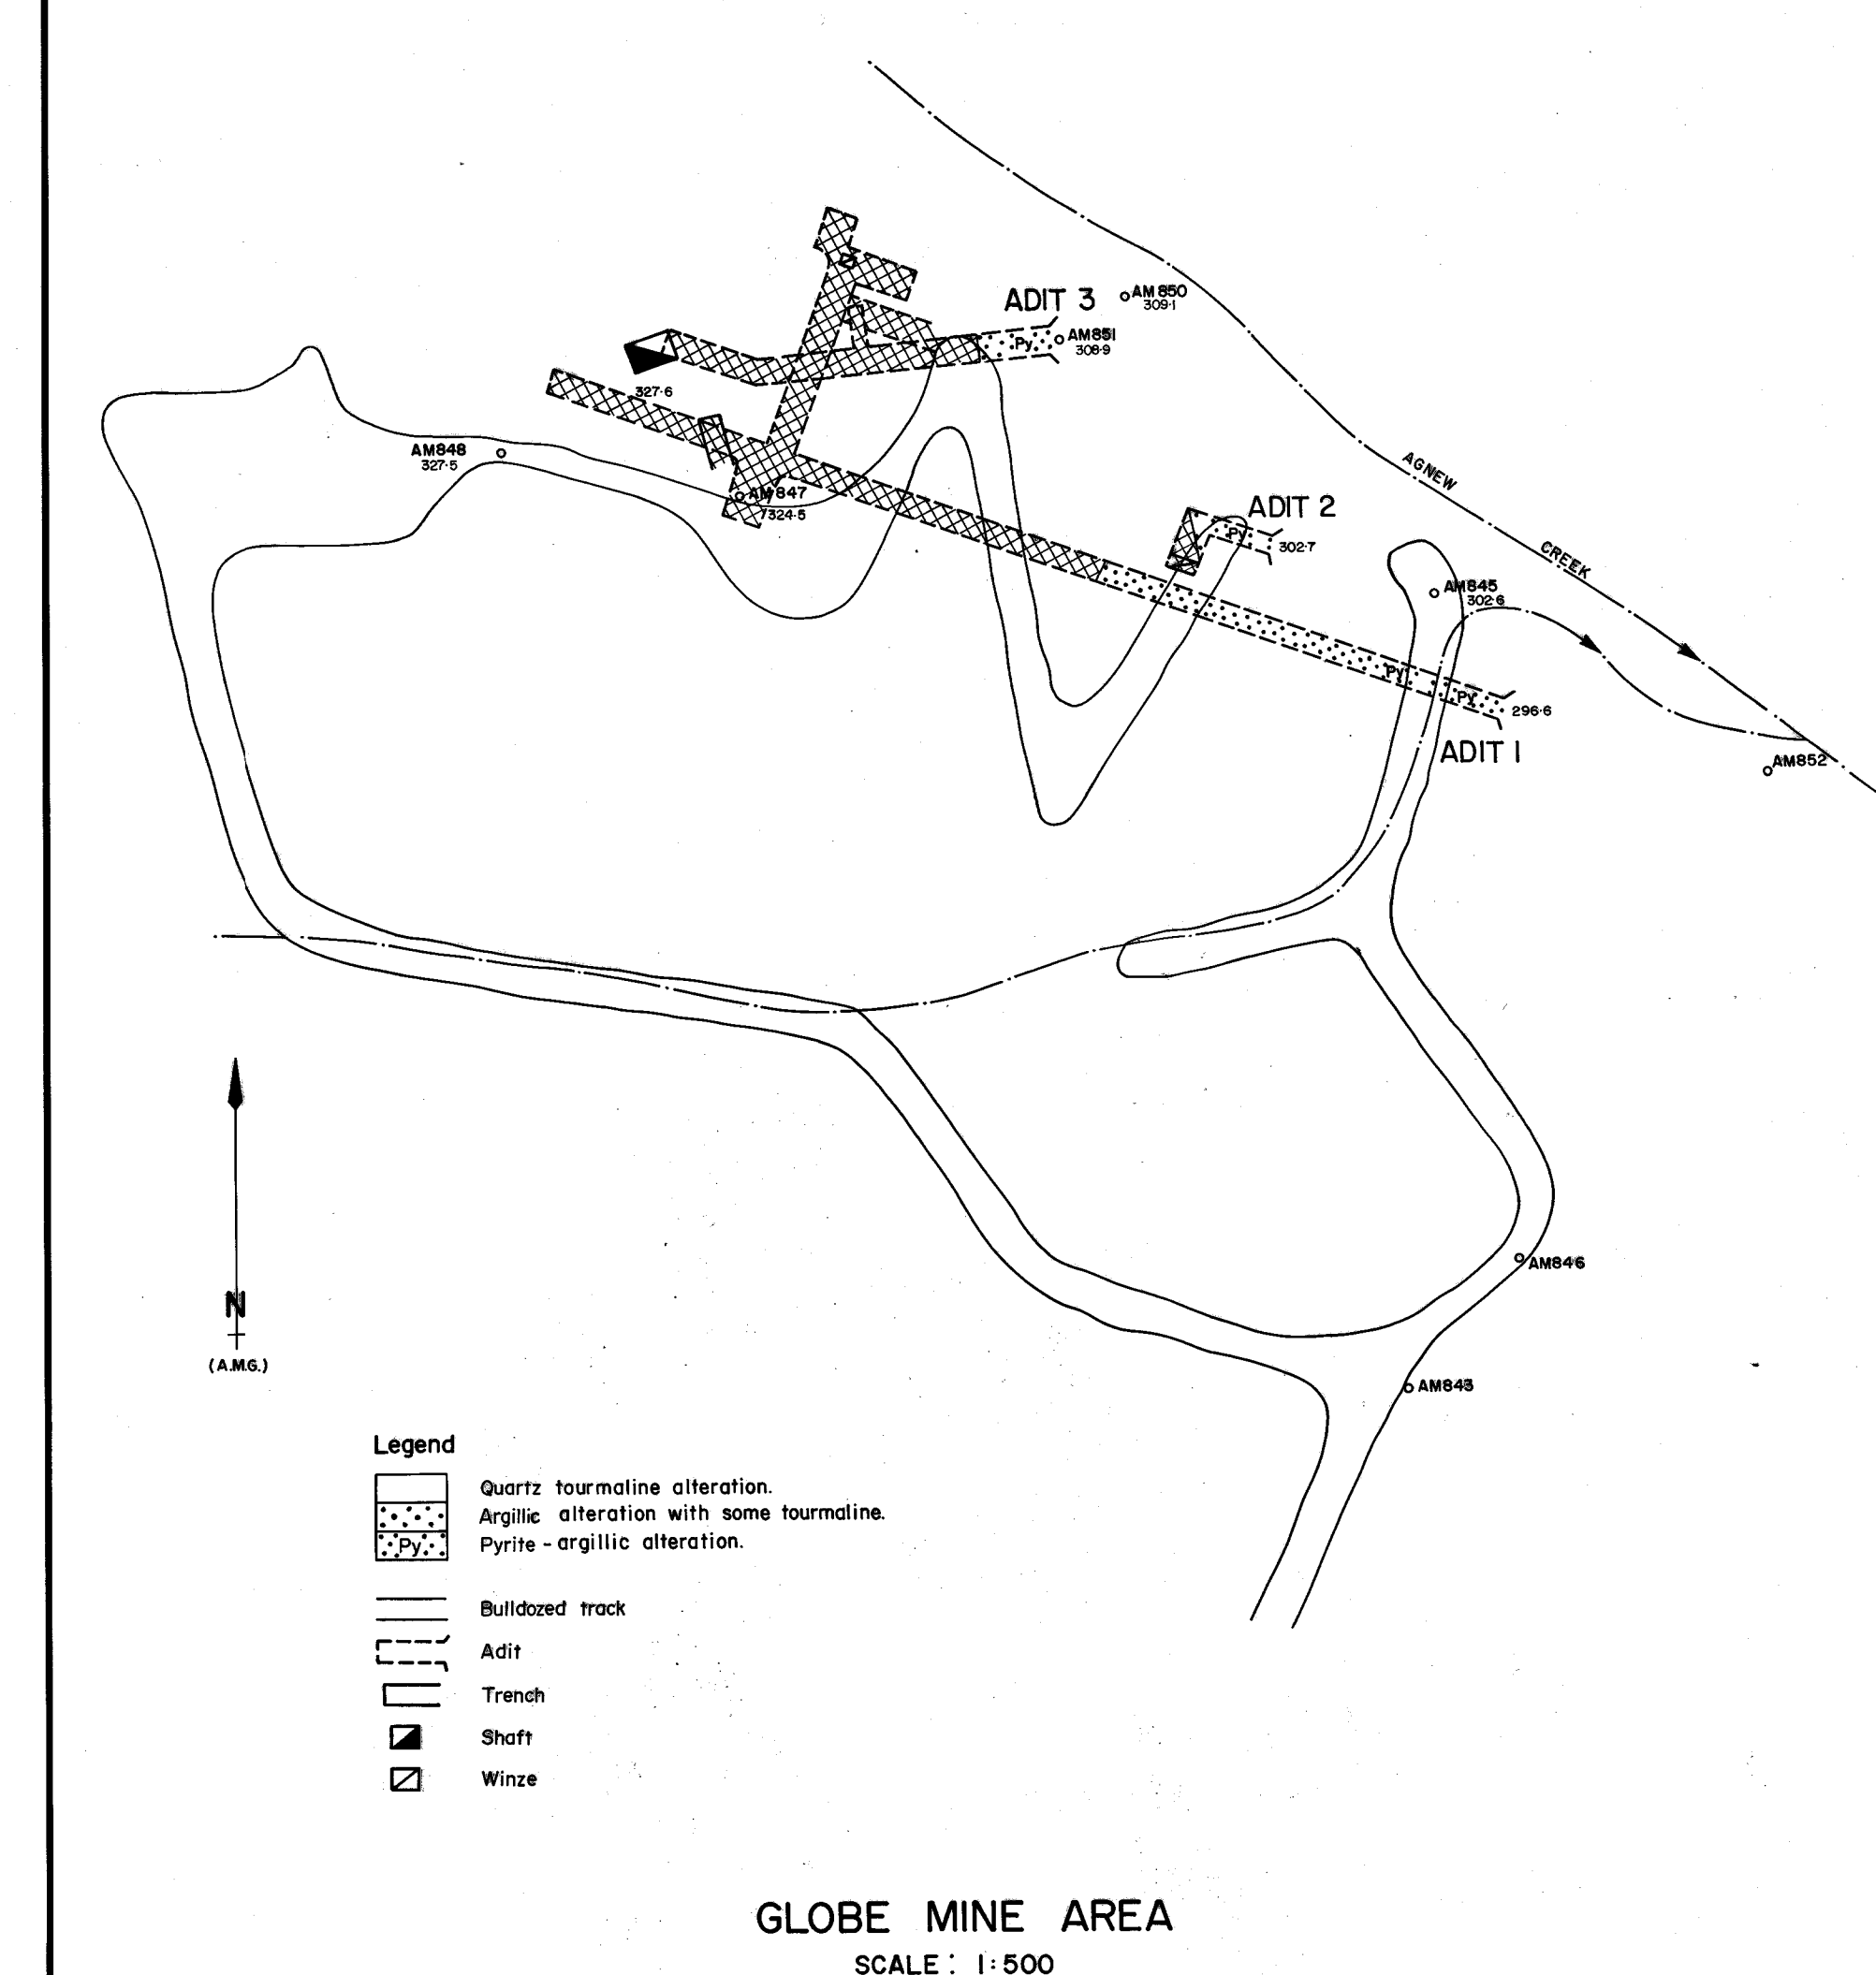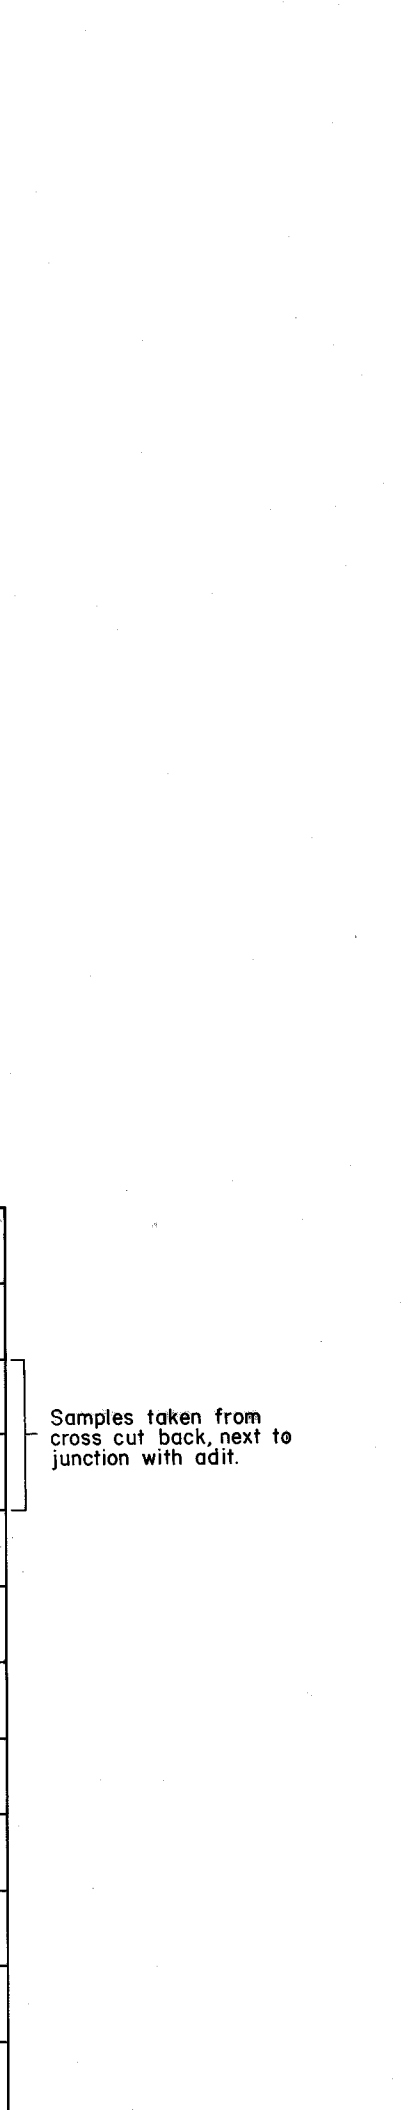

N.B. As: 0.1%, except Sample No. 10: 0.1%,
15: 0.1%,
16: 0.2%,
24: 2.6%,
33-34: 0.54%
B: 0.007%, except Sample No. 33: 0.007%,
1-2N: 0.006%

Sample No.	%Sn	%SSn	%Ag	%Zn	%Pb	%Cu	%W	%S	%Sb
1	0.03	0.01	166	0.01	0.28	0.02	0.01	0.2	0.11
2	0.05	0.01	18	0.01	0.06	0.01	0.01	0.01	0.33
3	0.02	0.01	145	0.01	0.25	0.02	0.01	0.1	0.08
4	0.03	0.01	250	0.01	0.42	0.02	0.01	0.4	0.18
5	0.05	0.02	97	0.01	0.22	0.02	0.01	0.3	0.09
6	0.07	0.02	99	0.01	0.32	0.03	0.01	0.2	0.12
7	0.04	0.02	95	0.01	0.24	0.02	0.01	0.2	0.10
8	0.03	0.02	42	0.01	0.22	0.03	0.01	0.1	0.09
9	0.04	0.01	40	0.06	0.10	0.04	0.01	0.9	0.06
10	0.11	0.01	52	0.20	0.33	0.08	0.01	9.6	0.09
11	0.26	0.01	59	0.11	0.08	0.06	0.01	2.5	0.03
12	0.03	0.01	38	0.02	0.30	0.05	0.01	0.6	0.06
13	0.03	0.01	57	0.02	0.29	0.06	0.01	0.6	0.10
14	0.04	0.01	86	0.04	0.63	0.04	0.01	0.9	0.13
15	0.03	0.01	215	3.48	2.72	0.36	0.01	4.9	0.61
16	0.02	0.01	250	0.44	2.99	0.35	0.01	2.9	0.52
17	0.06	0.01	153	0.14	0.30	0.04	0.01	0.6	0.14
18	0.06	0.01	82	0.22	0.30	0.09	0.01	0.8	0.10
19	0.02	0.01	128	0.09	0.35	0.13	0.01	0.7	0.17
20	0.03	0.01	290	0.28	1.33	0.17	0.01	1.5	0.45
21	0.05	0.01	76	0.01	0.41	0.05	0.01	0.2	0.12
22	0.03	0.01	217	0.02	0.44	0.07	0.01	0.2	0.23
23	0.07	0.01	215	0.02	0.85	0.06	0.01	0.3	0.36
24	0.11	0.01	195	0.04	4.35	0.12	0.01	1.2	0.37
25	0.01	0.01	138	0.01	0.19	0.04	0.01	0.1	0.10
26	0.02	0.01	125	0.01	0.70	0.03	0.01	0.3	0.19
27	0.02	0.01	63	0.03	0.75	0.03	0.01	0.1	0.18
28	0.03	0.01	56	0.01	0.14	0.03	0.01	0.01	0.05
29	0.05	0.01	37	0.02	0.16	0.03	0.01	0.1	0.04
30	0.03	0.01	180	0.03	0.37	0.07	0.01	0.5	0.13
31	0.02	0.01	88	0.09	0.19	0.06	0.01	0.3	0.07
32	0.02	0.01	132	0.01	0.07	0.02	0.01	0.1	0.04

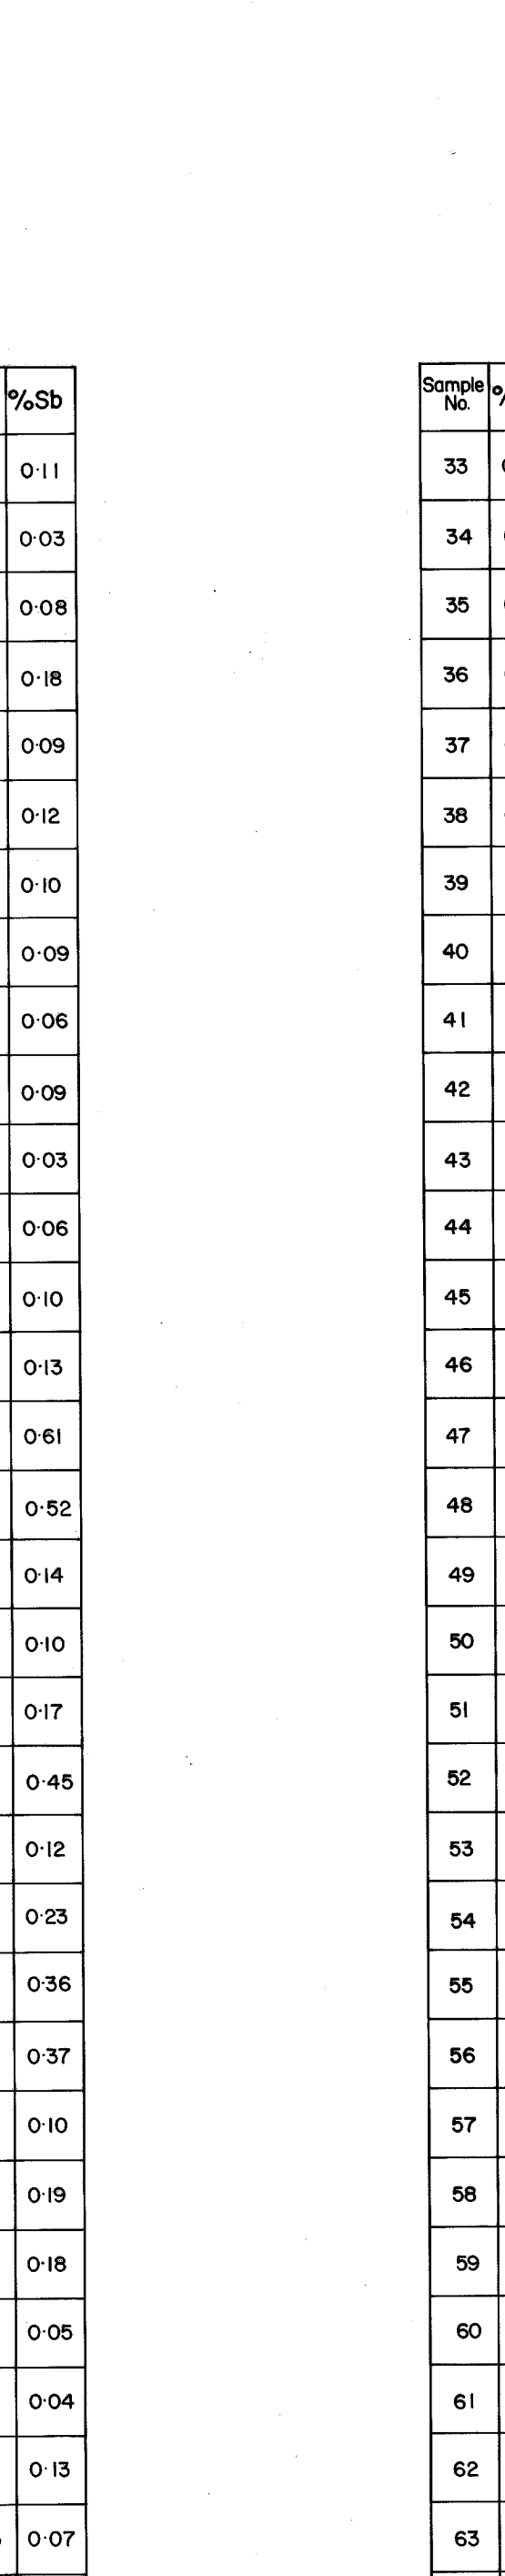

Sample No.	%Sn	%SSn	%Ag	%Zn	%Pb	%Cu	%W	%S	%Sb
33	0.03	0.01	300	0.03	0.39	0.03	0.01	0.2	0.13
34	0.13	0.08	200	4.90	0.74	0.13	0.01	6.6	0.15
35	0.04	0.01	15	0.01	0.08	0.01	0.01	0.1	0.01
36	0.02	0.01	10	0.03	0.09	0.03	0.01	0.1	0.01
37	0.02	0.01	10	0.01	0.06	0.01	0.01	0.1	0.01
38	0.02	0.01	43	0.01	0.24	0.02	0.01	0.2	0.04
39	0.04	0.01	107	0.03	0.19	0.03	0.01	0.2	0.07
40	0.02	0.01	20	0.01	0.05	0.02	0.01	0.1	0.01
41	0.02	0.01	52	0.01	0.44	0.02	0.01	0.1	0.03
42	0.06	0.01	35	0.01	0.22	0.03	0.01	0.1	0.04
43	0.02	0.01	53	0.02	0.22	0.04	0.01	0.6	0.04
44	0.03	0.01	240	0.02	0.31	0.03	0.01	0.4	0.12
45	0.06	0.01	67	0.06	0.17	0.19	0.01	1.3	0.07
46	0.03	0.01	66	0.02	0.05	0.07	0.01	0.9	0.07
47	0.03	0.01	38	0.01	0.11	0.02	0.01	0.4	0.05
48	0.03	0.01	132	0.01	0.14	0.02	0.01	0.1	0.07
49	0.02	0.01	24	0.01	0.18	0.02	0.01	0.1	0.06
50	0.04	0.01	32	0.01	0.16	0.02	0.01	0.2	0.05
51	0.03	0.01	136	0.01	0.35	0.03	0.01	0.3	0.08
52	0.02	0.01	47	0.01	0.14	0.01	0.01	0.1	0.05
53	0.02	0.01	50	0.01	0.16	0.02	0.01	0.3	0.07
54	0.04	0.01	85	0.01	0.22	0.04	0.01	0.2	0.09
55	0.03	0.01	6	0.01	0.11	0.02	0.01	0.1	0.01
56	0.01	0.01	35	0.01	1.11	0.02	0.01	2.7	0.01
57	0.02	0.01	5	0.01	0.03	0.02	0.01	0.3	0.01
58	0.02	0.01	3	0.01	0.06	0.04	0.01	0.3	0.01
59	0.03	0.01	5	0.01	0.02	0.03	0.01	0.6	0.01
60	0.04	0.01	3	0.01	0.07	0.02	0.01	0.2	0.01
61	0.03	0.01	7	0.01	0.16	0.02	0.01	0.8	0.01
62	0.02	0.01	15	0.01	0.02	0.02	0.01	0.1	0.01
63	0.01	0.01	19	0.01	0.01	0.02	0.01	0.4	0.01



Sample No.	%Sn	%SSn	%Ag	%Zn	%Pb	%Cu	%W	%S	%Sb
64	0.01	0.01	0.03	0.11	0.01	11	0.01	0.27	
65	0.01	0.01	0.03	0.13	0.01	4	0.01	0.04	
66	0.01	0.01	0.03	0.06	0.01	3	0.01	0.03	
67	0.01	0.01	0.03	0.09	0.01	4	0.01	0.18	
68	0.01	0.01	0.03	0.03	0.02	3	0.01	0.16	
69	0.01	0.01	0.03	0.18	0.06	4	0.01	0.16	
70	0.01	0.01	0.03	0.07	0.08	7	0.01	0.08	
71	0.01	0.01	0.10	0.13	1.58	52	0.01	0.24	
72	0.01	0.01	0.02	0.13	0.25	7	0.01	0.72	
73	0.01	0.01	0.02	0.05	0.01	5	0.01	0.07	
74	0.01	0.01	0.02	0.07	0.01	2	0.01	0.02	
75	0.01	0.01	0.02	0.01	0.01	1	0.01	0.01	
76	0.01	0.01	0.03	0.01	0.01	2	0.01	0.03	
77	0.01	0.01	0.02	0.01	0.01	3	0.01	0.01	

